

# Table of Contents

<b>1.0</b>	<b>Table of Contents</b>	1.365	Insulation material, PE foam PUR foam containers
<b>1.1</b>	<b>System description</b>	1.370	Screwed connectors, outer thread, weld end
1.100	System description (general)	1.375	Screwed connectors, coupling: equal, reduced
1.105	System description (data)	1.380	Compression connectors, thread, weld end with sliding sleeve
1.106	System description (data)	1.385	Compression connectors, coupling, angle 90° with sliding sleeve
1.110	Long-term behaviour/lifetime calculation	1.390	Compression T-piece, with sliding sleeve, heating 6 bar
1.115	CALPEX UNO range, heating 6 bar – structure, dimensions, materials, weights and delivery lengths	1.395	Compression T-piece, with sliding sleeve, sanitary 10 bar
1.116	CALPEX DUO range, heating 6 bar – structure, dimensions, materials, weights and delivery lengths	1.400	Electro-fusion joint
1.120	CALPEX UNO/DUO range, sanitary 10 bar – structure, dimensions, materials, weights and delivery lengths	1.405	End cap, standard, shrinkable
1.125	CALPEX QUADRIGA range, heating 6 bar, sanitary 10 bar – structure, dimensions, materials, weights and delivery lengths	1.410	Wall sealing ring, for wall openings
<b>1.2</b>	<b>Planning, design engineering</b>	1.415	Building entry, wall opening/core bore
1.200	Pressure loss chart, heating, 6 bar	1.420	Wall seal, core bores/cement pipe liners
1.205	Pressure loss chart, sanitary, 10 bar	1.425	Building entry, core bores/cement pipe liners
1.210	Heat loss, heating, 6 bar	<b>1.5</b>	<b>Underground construction, installation</b>
1.215	Heat loss, sanitary, 10 bar	1.500	Pipe routing
1.220	Heat loss, heating 6 bar, sanitary 10 bar, QUADRIGA	1.505	Trench dimensions
1.225	Planning and connection technology, heating strip, sanitary, 10 bar	1.510	Pipe warning tape, laying tools
<b>1.3</b>	<b>Components</b>	1.515	Connection (rigid/flexible), CALPEX plastic casing pipe
1.300	House entry bend 90°, heating 6 bar, UNO	1.520	House entry, screwed connector, shaft entry, fixed point forces
1.301	House entry bend 90°, heating 6 bar, DUO	1.525	House connection, compression joint, shaft entry, fixed point forces
1.305	House entry bend 90°, sanitary 10 bar, UNO and DUO	1.530	Installation of house entry
1.310	House entry bend 90°, heating 6 bar, sanitary 10 bar, QUADRIGA	1.535	Installation tool, general and for screwed connector
1.315	CALPEX L-shell	1.540	Installation tool, for joint with sliding sleeves
1.316	CALPEX Big L-shell	1.545	Heating strip, sanitary, 10 bar, drawing in, sensor, joint
1.320	Joint (PE-HD shrink sleeve)		
1.325	CALPEX I-shell		
1.326	CALPEX Big I-shell		
1.330	CALPEX T-shell		
1.335	CALPEX Big T-shell		
1.336	CALPEX-PE-T-Shell		
1.340	T-joint		
1.345	Y-pipe, heating, 6 bar		
1.350	Distribution chamber		
1.355	Distribution chamber, installation		
1.360	Concrete protective plate for distribution shaft		

# System description

## 1. General

CALPEX district heating pipe is the registered trade name for a flexible pipe system from Brugg Pipe Systems, specifically designed for the low temperature use. It is ideal for use in small and midsize district and local heating networks, in industrial and agricultural applications, for drinking water supplies, sewage systems, cooling systems and swimming pool installations.

CALPEX district heating pipe has a carrier pipe made of cross-linked polyethylene, PEXa. This material was selected because of its excellent thermal and mechanical properties. It is a corrosion-proof and chemically resistant material. The product is free of harmful substances, making it exceptionally environment-friendly.

The PEXa pipe in the heating series is equipped with an oxygen diffusion barrier (EVOH).

The thermal insulation is CFC-free flexible rigid polyurethane foam with excellent insulation values.

The bending capability of CALPEX district heating pipe means that it is generally possible to pass over or under existing supply pipes and obstacles can be easily bypassed.

With CALPEX district heating pipe, users can choose the shortest pipe route without the restrictions required by the classical method of pipe construction.

The flexible CALPEX district heating pipe is delivered to the site continuously in coils or on a cable drum. Long delivery lengths enable pipes to be laid in the ground largely without joints. This means that the pipe trench can be considerably narrower. This in turn allows considerable savings on underground work, especially as regards DUO pipes.

Taking account of the very short time required for installation, CALPEX district heating pipe is not only the technically ideal solution but also the key to saving time and expense when setting up district heating networks; less coordination is required on site and the pipes are laid simply and quickly.

The physical properties of the PEXa pipe combined with the composite insulation mean that thermal expansion can be ignored when using this product.

Installing the connecting pieces is very simple. The joints are fitted quickly and reliably with conventional screwed connectors, compression joints or electrofusion joints. The wide range of accessories ensures that solutions can be chosen for every possible situation.

**CALPEX district heating pipes are manufactured according to the current standard (EN 15632-1 /-2).**

## 2. Range of applications

### Heating, pipe series 5 (SDR 11):

Max. temp. for continuous operation  $T_{Bmax}$ : 80 °C  
 Max. permitted operating temp.  $T_{max}$ : 95 °C (fluctuating)  
 Max. permitted operating pressure p: 6 bar

see sheet CPX 1.110

### Sanitary, pipe series 3.2 (SDR 7.4):

Max. temp. for continuous operation  $T_{Bmax}$ : 80 °C  
 Max. permitted operating temp.  $T_{max}$ : 95 °C (fluctuating)  
 Max. permitted operating pressure p: 10 bar

see sheet CPX 1.110

# System description

## 1. Bonded system

Requirements: Factory insulated, flexible pipe systems according EN 15632-1/-2  
 Fire behaviour: Building material class B2 (normally inflammable) according to DIN 4102

## 2. Carrier pipe

Materials Basic material: High-density polyethylene (PE-HD), peroxide cross-linked (PEXa), colour: natural  
 Bonding agent PE-modified, heat-stabilized, colour: red (heating), silver (sanitary)  
 Oxygen barrier layer Ethylene / vinyl alcohol (EVOH), heat-stabilized, colour: natural  
 Requirements As per DIN 16892 / DIN 16893 and E DIN EN 12318-2, pipes in series 3.2 as per DVGW worksheet W 544  
 Impermeability to oxygen As per DIN 4729 at 40 °C, oxygen permeability based on the interior pipe volume as per DIN 4726 from  $\leq 0.10 \text{ g}/(\text{m}^3 \times \text{d})$   
 Pipe series DIN 16893 Series 5 (SDR 11): for heating (with EVOH barrier)  
 Series 3.2 (SDR 7.4): for sanitary (with EVOH barrier)  
 Long-term behaviour See catalog sheet CPX 1.110  
 Properties Unaffected by aggressive water; low pressure losses; very good chemical and mechanical resistance (DIN 8075 sheet 1)

PEXa carrier pipe	Reference temperature °C	Value	Test standard
Density	-	932 - 935 kg/m <sup>3</sup>	ISO 1183
Thermal conductivity	-	0.38 W/mK	in Anlehnung an ASTM C 1113
Tensile strength	20	min. 18 N/mm <sup>2</sup>	ISO 6259
Tensile strength	80	min. 8 N/mm <sup>2</sup>	ISO 6259
Linear expansion coefficient	20	$1.4 \cdot 10^{-4} \text{ 1/K}$	-
Linear expansion coefficient	100	$2.0 \cdot 10^{-4} \text{ 1/K}$	-
Crystallite melting range	-	128 - 134 °C	-
Chem. resistance	20 / 40 / 60	-	DIN 8075 B.1

**3. Thermal insulation**

Materials:

**CALPEX heating**

CFC-free, cyclopentane-blown polyurethane foam (PUR)

**CALPEX sanitary**

CFC-free, 100 % CO<sub>2</sub>-blown polyurethane foam (PUR)

PUR insulation	Reference temperature °C	CALPEX heating	CALPEX sanitary	Test standard
Density	-	> 50 kg/m <sup>3</sup>	> 50 kg/m <sup>3</sup>	EN 253
Axial shear strength	-	≥ 90 kPa	-	EN 15632-2
Thermal conductivity flexible systems ≤ Ø 142	50	≤ 0.0199 W/mK	≤ 0.0234 W/mK	EN 253 and ISO 8497
Thermal conductivity flexible systems > Ø 142	50	≤ 0.0216 W/mK	≤ 0.0234 W/mK	EN 253 and ISO 8497
Thermal conductivity rigid systems	50	≤ 0.0260 W/mK	-	EN 253 and ISO 8497
Percentage of closed cells	-	≥ 88 %	≥ 90 %	EN 253
Water absorption	100	≤ 10 %	≤ 10 %	EN 15632-1

**4. Protective casing**

Materials:

linear polyethylene, low density (LLD-PE), seamlessly extruded

Purpose:

mechanical protection and moisture resistance

LLD-PE protective casing	Reference temperature °C	Value	Test standard
Density	-	918 - 922 kg/m <sup>3</sup>	ASTM D792
Thermal conductivity	-	0.33 W/mK	DIN 52612
Graphite content	-	> 2%	EN 15632-1

# Long-term behaviour

## Lifetime calculation

Operating temperature: °C	Heating (pipe series 5 / SDR 11) Operating pressure (bar)					Sanitary (pipe series 3.2 / SDR 7.4) Operating pressure (bar)				
	1 year	5 year	10 year	25 year	50 year	1 year	5 year	10 year	25 year	50 year
10	17.9	17.5	17.4	17.2	17.1	28.3	27.8	27.6	27.3	27.1
20	15.8	15.5	15.4	15.2	15.1	25.1	24.6	24.4	24.2	24.0
30	14.0	13.8	13.7	13.5	13.4	22.3	21.9	21.7	21.4	21.3
40	12.5	12.2	12.1	12.0	11.9	19.8	19.4	19.3	19.1	18.9
50	11.1	10.9	10.8	10.7	10.6	17.7	17.3	17.2	17.0	16.8
60	9.9	9.7	9.7	9.5	9.5	15.8	15.5	15.3	15.2	15.0
70	8.9	8.7	8.6	8.5	8.5	14.1	13.8	13.7	13.6	13.4
80	8.0	7.8	7.7	7.6	-	12.7	12.4	12.3	12.1	-
90	7.2	7.0	6.9	-	-	11.4	11.1	11.0	-	-
95	6.8	6.6	6.6	-	-	10.8	10.6	10.5	-	-

1 MPA = 10 bar

### Long-term behaviour: (table)

The values have a safety factor of 1.25 and are based on a series of measurements covering an average of 32,000 hours. They can be compared with Table 5 as per DIN 16893. All values have been tested and confirmed by the competent organizations in various countries. The max. operating temperature is 95 °C but considers a short-term over temperature (fault temperature) of 110 °C.

A typical fluctuating temperature distribution for the flow in a district heating system gives an average temperature/year of approx. 66 °C.

### Lifetime calculation using Miner's Rule

Lifetime calculation for fluctuating operating temperatures will be calculated acc. EN ISO 13760.

### Example of application

The basis is a typical temperature collective over one year, with fluctuating operation. (gem. EN 15632-2)

1 year = 365 days = 8760 hours.

Operating Temperature °C	Example 1 Annual Operating time h	Example 2 Annual Operating time h	Example 3 Annual Operating time h
95	3,3	0	0
90	292	50	50
85	0	100	1000
80	8468	200	3450
75	0	2000	1000
70	0	2410	0
65	0	4000	0
60	0	0	0
total	8763,3	8760	5500

Example 1: life time of 30 years

Example 2: life time of 50 years


Example 3: life time of 40 years

# CALPEX UNO range

Heating, 6 bar


## CALPEX in coils:

Dimensions:  
CPX Ø 76 - 202 mm

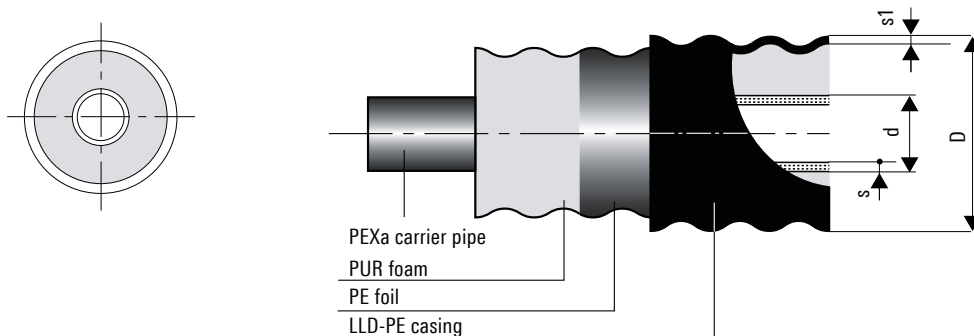

## CALPEX in straight lengths:

Dimensions:  
CPX Ø 250 mm

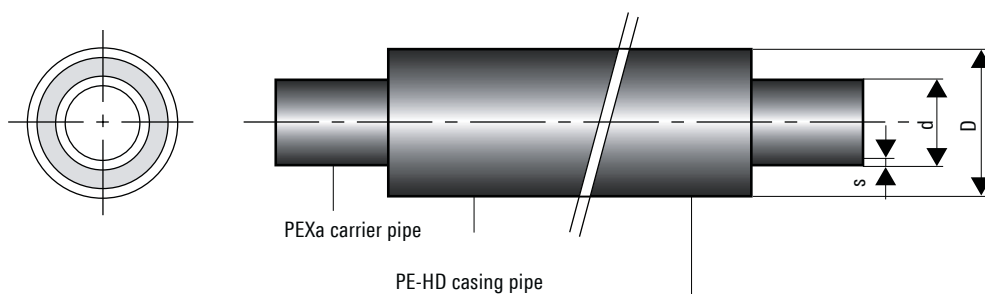

## CALPEX heating, 6 bar, UNO

Type	PEX carrier pipe d x s mm	Nominal diameter		Outer casing D x s1 mm	Minimum bending radius m	Volume Carrier pipe l/m	Weight kg/m	Maximum delivery lengths**	
		DN	Inches "					Jumbo coil m	Maxi coil m
25/ 76*	25 x 2.3	20	¾	78 x 1.9	0.45	0.32	0.90	700	1000
25/ 91 PLUS*				93 x 2.1	0.65	0.32	1.20	450	715
32/ 76*	32 x 2.9	25	1	78 x 1.9	0.50	0.53	1.00	700	1000
32/ 91 PLUS*				93 x 2.1	0.70	0.53	1.40	450	715
40/ 91*	40 x 3.7	32	1¼	93 x 2.1	0.55	0.83	1.40	450	715
40/111 PLUS*				113 x 2.3	0.75	0.83	1.70	300	450
50/111*	50 x 4.6	40	1½	113 x 2.3	0.60	1.30	1.97	300	450
50/126 PLUS*				128 x 2.7	0.80	1.30	2.40	192	291
63/126*	63 x 5.8	50	2	128 x 2.7	0.65	2.07	2.60	192	291
63/142 PLUS*				143 x 2.9	0.85	2.07	3.10	160	260
75/142*	75 x 6.8	65	2½	143 x 2.9	0.70	2.96	3.39	160	260
75/162 PLUS				163 x 3.2	0.90	2.96	3.90	92	149
90/162	90 x 8.2	80	3	163 x 3.2	1.00	4.25	4.56	92	149
90/182 PLUS				183 x 3.3	1.20	4.25	4.80	52	86
110/162	110 x 10.0	100	4	163 x 3.2	1.10	6.36	5.70	92	149
110/182				183 x 3.3	1.20	6.36	6.60	52	86
110/202 PLUS***				202 x 3.3	1.40	6.36	6.80	46	80
125/182	125 x 11.4	125	5	183 x 3.3	1.30	8.20	7.20	52	86
125/202 PLUS***				202 x 3.3	1.50	8.20	7.80	46	80
140/202	140 x 12.7	125	5	202 x 3.3	1.40	10.31	8.40	46	80
160/250	160 x 14.6	150	6	250 x 3.9	-	13.43	11.80	12	12

\* CALPEX PUR-KING with  $\lambda_{50}$  0.0199 W/mK

\*\* Supply as section length, as coils and on drums possible. The delivered coil length may vary (+/- 5%)

\*\*\* Available on request

- We will produce different dimensions or special items on request.
- Larger or smaller delivery lengths can be supplied on drums if requested.
- Coil dimensions: **Jumbo coil** outer diameter 2800 mm x 800 mm (width)  
**Maxi coil** outer diameter 2800 mm x 1200 mm (width)

When ordering at the construction site, please observe the total weight of the coil (unwinding equipment)



# CALPEX DUO range

Heating, 6 bar

**CALPEX in coils:**

Dimensions:

CPX Ø 76 - 202 mm

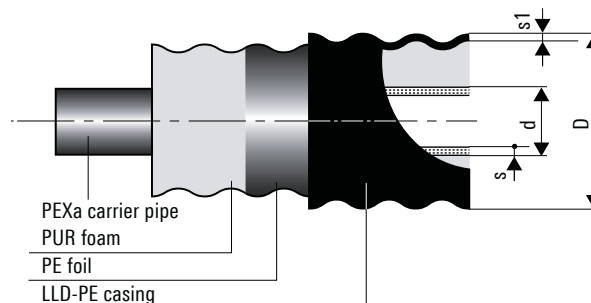

**CALPEX heating, 6 bar, DUO**

Type	PEX carrier pipe d x s mm	Nominal diameter		Outer casing D x s1 mm	Minimum bending radius m	Volume Carrier pipe l/m	Weight kg/m	Maximum delivery lengths**	
		DN	Inches "					Jumbo coil m	Maxi coil m
25 + 25/ 91*	2 x 25 x 2.3	20 + 20	2 x ¾	93 x 2.1	0.55	2 x 0.32	1.34	450	715
25 + 25/111 PLUS*				113 x 2.3	0.75	2 x 0.32	1.60	300	450
32 + 32/111*	2 x 32 x 2.9	25 + 25	2 x 1	113 x 2.3	0.60	2 x 0.53	1.90	300	450
32 + 32/126 PLUS*				128 x 2.7	0.80	2 x 0.53	2.30	192	291
40 + 40/126*	2 x 40 x 3.7	32 + 32	2 x 1¼	128 x 2.7	0.65	2 x 0.83	2.50	192	291
40 + 40/142 PLUS*				143 x 2.9	0.85	2 x 0.83	3.00	160	260
50 + 50/162	2 x 50 x 4.6	40 + 40	2 x 1½	163 x 3.2	1.10	2 x 1.30	4.00	92	149
50 + 50/182 PLUS				183 x 3.3	1.30	2 x 1.30	4.70	52	86
63 + 63/182	2 x 63 x 5.8	50 + 50	2 x 2	183 x 3.3	1.20	2 x 2.07	5.30	52	86
63 + 63/202 PLUS***				202 x 3.3	1.40	2 x 2.07	6.00	46	80
75 + 75/202***	2 x 75 x 6.8	65 + 65	2½ x 2½	202 x 3.3	1.40	2 x 2.96	6.90	46	80

\* CALPEX PUR-KING with  $\lambda_{50}$  0.0199 W/mK

\*\* Supply as section length, as coils and on drums possible. The delivered coil length may vary (+/- 5%)


\*\*\* Available on request

- We will produce different dimensions or special items on request.
- Larger or smaller delivery lengths can be supplied on drums if requested.
- Coil dimensions: **Jumbo coil** outer diameter 2800 mm x 800 mm (width)  
**Maxi coil** outer diameter 2800 mm x 1200 mm (width)

**When ordering at the construction site, please observe the total weight of the coil (unwinding equipment)**

# CALPEX UNO/DUO range

Sanitary, 10 bar

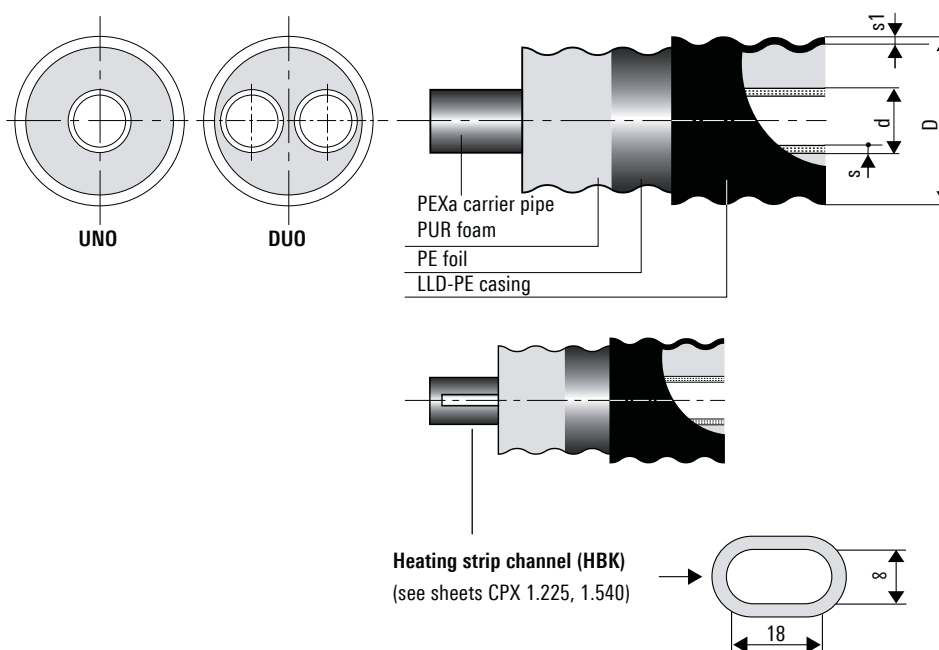

## CALPEX sanitary, 10 bar, UNO

Type	Nominal diameter		PEX carrier pipe d x s mm	Outer casing D x s1 mm	Minimum bending radius m	Volume carrier pipe l/m	Weight kg/m	Maximum delivery lengths*	
	DN	Inches "						Jumbo coil m	Maxi coil m
22/ 76	16	5/8	22 x 3.0	78 x 2.0	0.45	0.201	0.96	700	1000
28/ 76	20	3/4	28 x 4.0	78 x 2.0	0.50	0.314	1.06	700	1000
32/ 76	25	1	32 x 4.4	78 x 2.0	0.50	0.423	1.25	700	1000
40/ 91	32	1 1/4	40 x 5.5	93 x 2.2	0.55	0.660	1.77	450	715
50/111	40	1 1/2	50 x 6.9	113 x 2.4	0.60	1.029	2.50	300	450
63/126	50	2	63 x 8.7	128 x 2.7	0.65	1.633	3.40	192	291
32/111 HBK	25	1	32 x 4.4	113 x 2.4	0.60	0.423	1.83	300	450
40/126 HBK	32	1 1/4	40 x 5.5	128 x 2.7	1.00	0.660	2.49	192	291
50/126 HBK	40	1 1/2	50 x 6.9	128 x 2.7	1.00	1.029	2.76	192	291

## CALPEX sanitary, 10 bar, DUO

Type	Nominal diameter		PEX carrier pipe d x s mm	Outer casing D x s1 mm	Minimum bending radius m	Volume carrier pipe l/m	Weight kg/m	Maximum delivery lengths*	
	DN	Inches "						Jumbo coil m	Maxi coil m
28 + 22/91	20 + 16	3/4 + 5/8	28 x 4.0 + 22 x 3.0	93 x 2.2	0.55	0.314 + 0.201	1.47	450	715
32 + 22/111	25 + 16	1 + 5/8	32 x 4.4 + 22 x 3.0	113 x 2.4	0.60	0.423 + 0.201	1.95	300	450
40 + 28/126	32 + 20	1 1/4 + 3/4	40 x 5.5 + 28 x 4.0	128 x 2.7	0.65	0.660 + 0.314	2.60	192	291
50 + 32/126	40 + 25	1 1/2 + 1	50 x 6.9 + 32 x 4.4	128 x 2.7	0.65	1.029 + 0.423	1.77	192	291

\* Supply as section length, as coils and on drums possible. The delivered coil length may vary (+/- 5%)

- We will produce larger dimensions on request (Ø 75, 90, 110, 125 mm)
- Larger or smaller delivery lengths can be supplied on drums if requested.
- Coil dimensions:
 


<b>Jumbo coil</b>	outer diameter 2800 mm x 800 mm (width)
<b>Maxi coil</b>	outer diameter 2800 mm x 1200 mm (width)

When ordering at the construction site, please observe the total weight of the coil (unwinding equipment)



# CALPEX QUADRIGA range

Heating 6 bar, sanitary 10 bar

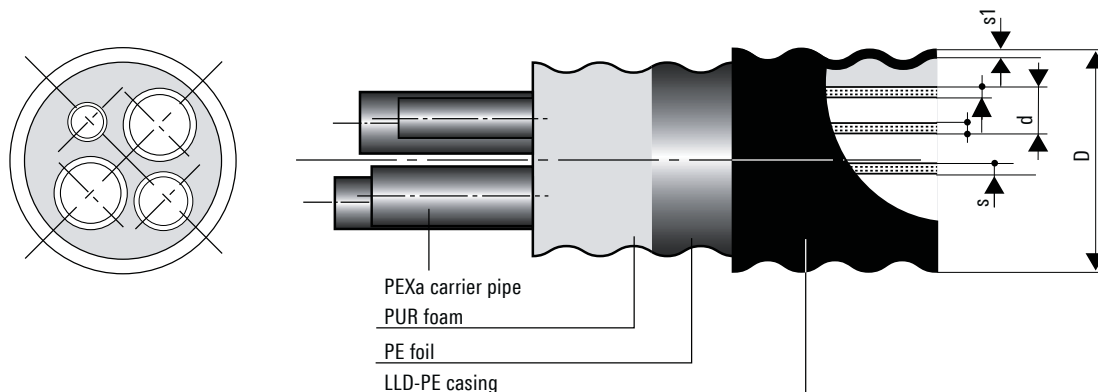

## CALPEX, heating 6 bar, sanitary 10 bar, QUADRIGA

Type	Nominal diameter		Carrier pipe d x s mm	Outer casing D x s1 mm	Minimum bending radius m	Volume carrier pipe l/m	Weight kg/m	Maximum delivery length*	
	DN	Inches "						Jumbo coil m	Maxi coil m
H25 + 25/S28 + 22/142	20	3/4	25 x 2.3	143 x 3.0	0.7	0.327	3.25	110	180
	20	3/4	25 x 2.3						
	20	3/4	28 x 4.0						
	16	5/8	22 x 3.0						
H32 + 32/S28 + 22/142	25	1	32 x 2.9	143 x 3.0	0.7	0.539	3.39	110	180
	25	1	32 x 2.9						
	20	3/4	28 x 4.0						
	16	5/8	22 x 3.0						
H32 + 32/S32 + 22/142	25	1	32 x 2.9	143 x 3.0	0.7	0.539	3.41	110	180
	25	1	32 x 2.9						
	25	1	32 x 4.4						
	16	5/8	22 x 3.0						
H40 + 40/S40 + 28/162	32	1 1/4	40 x 3.7	163 x 3.2	1.1	0.835	4.15	65	105
	32	1 1/4	40 x 3.7						
	32	1 1/4	40 x 5.5						
	20	3/4	28 x 4.0						

\* Supply as section length, as coils and on drums possible. The delivered coil length may vary (+/- 5%)

- We will produce different dimensions or special items on request.
- Larger or smaller delivery lengths can be supplied on drums if requested.
- Coil dimensions: **Jumbo coil** outer diameter 2800 mm x 800 mm (width)  
**Maxi coil** outer diameter 2800 mm x 1200 mm (width)

When ordering at the construction site, please observe the total weight of the coil (unwinding equipment)

# Pressure loss chart


Heating, 6 bar

Water temperature 80 °C

Surface roughness  $\epsilon = 0.007$  mm (PEXa)

(1 mmWS = 9.81 Pa)

$\dot{m} \approx \frac{Q \cdot 860}{\Delta T}$	$\dot{m}$ =	Flow rate in kg/h
	$Q$ =	Power requirement in kW
	$\Delta T$ =	Temperature difference VL (flow)/RL (return) in °C

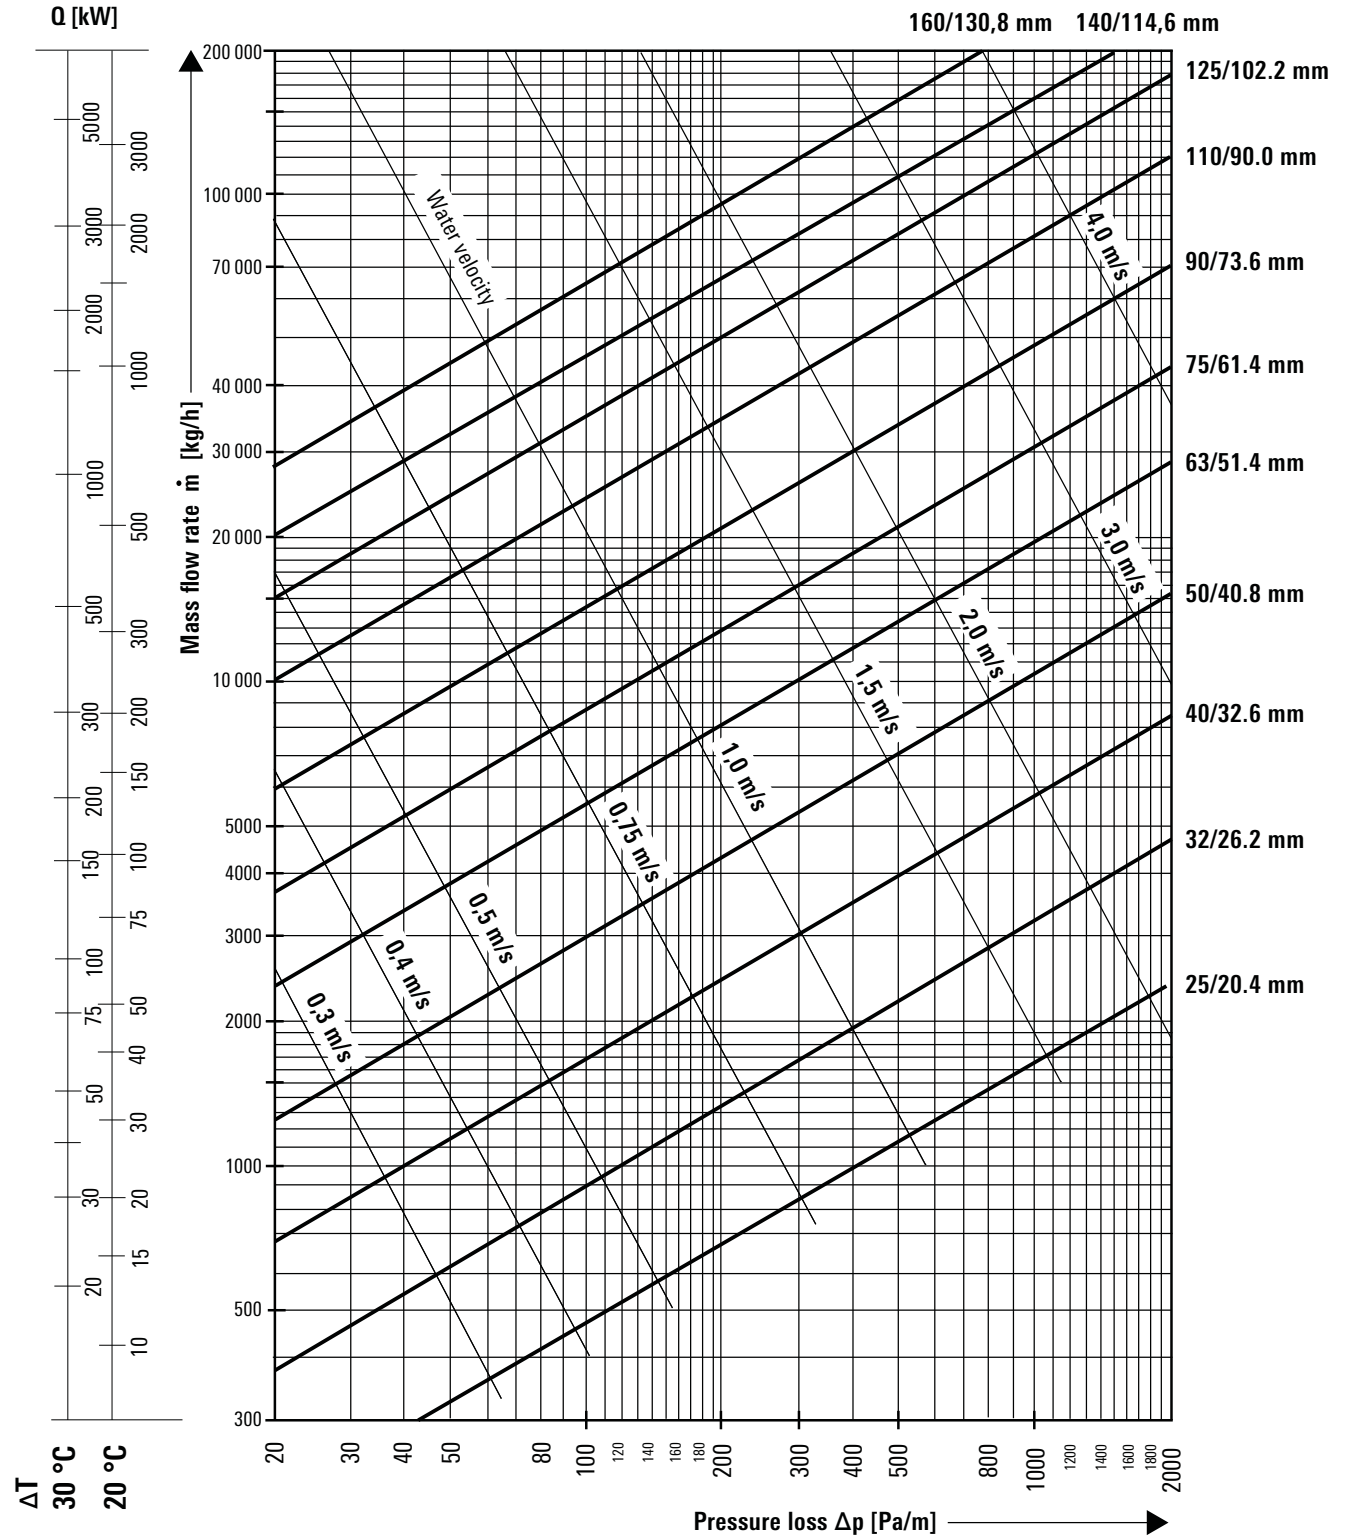


# Pressure loss chart

Sanitary, 10 bar

Water temperature 60 °C

Surface roughness  $\epsilon = 0.007$  mm (PEXa)

(1 mmWS = 9.81 Pa)

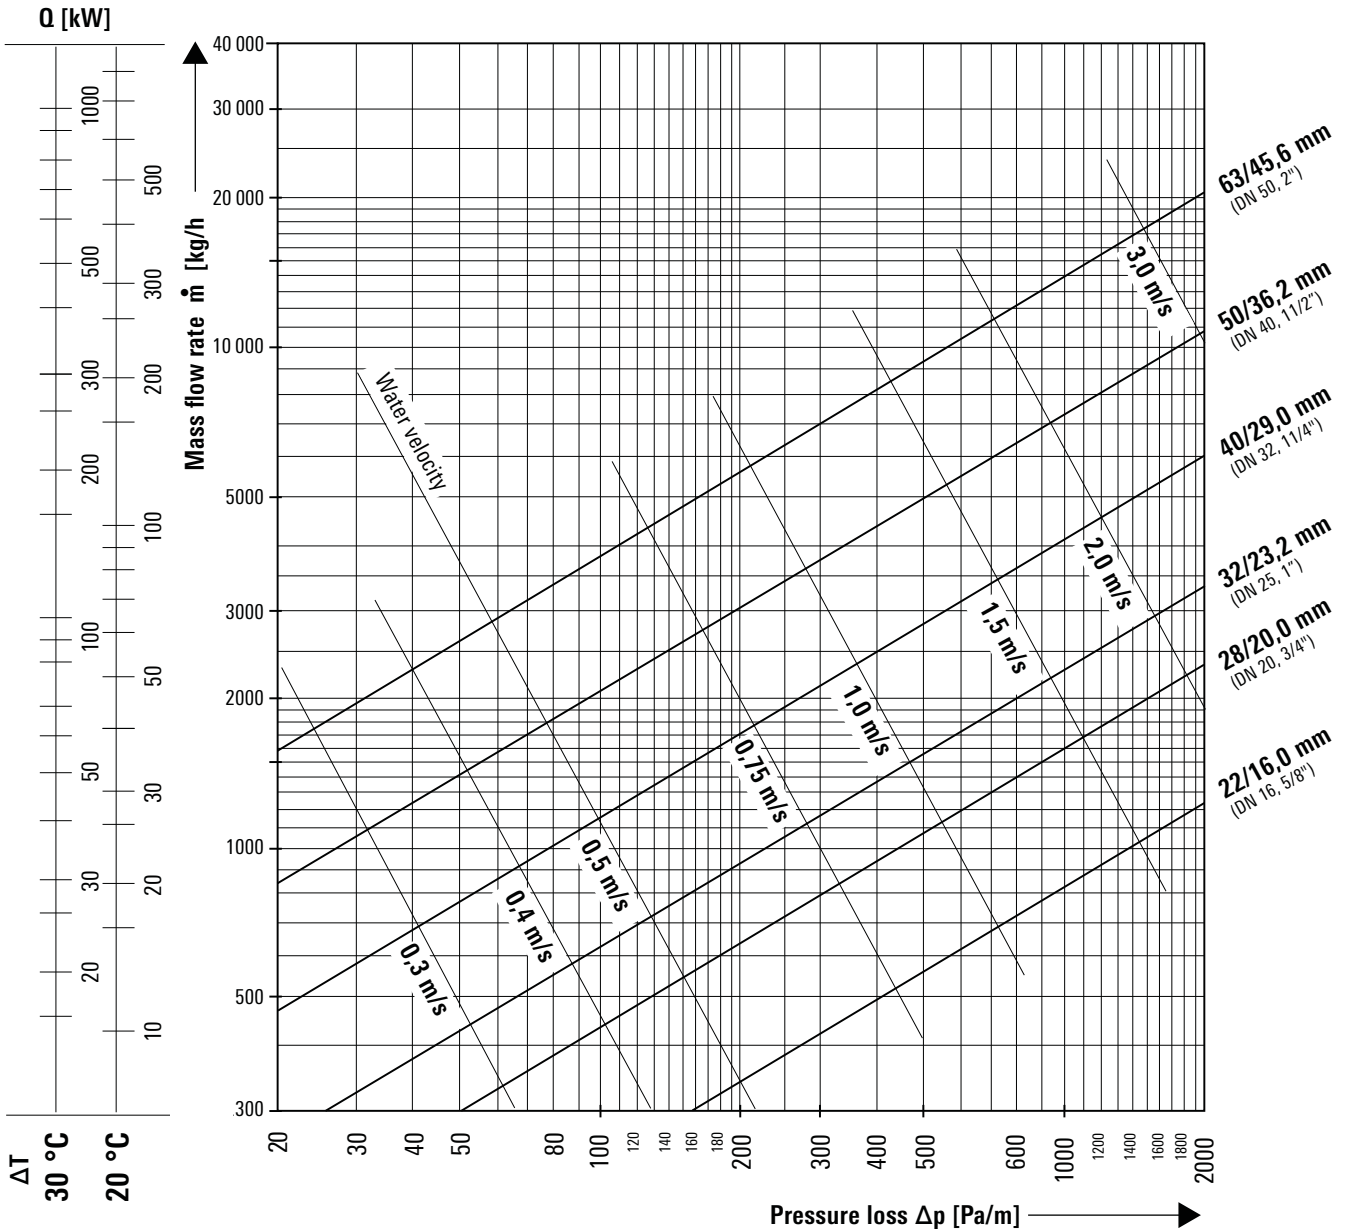


# Heat loss

Heating, 6 bar

## CALPEX / CALPEX PUR-KING UNO


Heat losses q [W/m] for one UNO pipe						
CALPEX UNO	U-value [W/mK]	Average operating temperature $T_B$ [°C]				
		40°	50°	60°	70°	80°
25/ 76*	0.1050	3.15	4.20	5.25	6.30	7.35
25/ 91 PLUS*	0.0910	2.73	3.64	4.55	5.46	6.37
32/ 76*	0.1320	3.96	5.28	6.60	7.92	9.24
32/ 91 PLUS*	0.1110	3.33	4.44	5.55	6.66	7.77
40/ 91*	0.1380	4.14	5.52	6.90	8.28	9.66
40/111 PLUS*	0.1140	3.42	4.56	5.70	6.84	7.98
50/111*	0.1420	4.26	5.68	7.10	8.52	9.94
50/126 PLUS*	0.1260	3.78	5.04	6.30	7.56	8.82
63/126*	0.1620	4.86	6.48	8.10	9.72	11.34
63/142 PLUS*	0.1420	4.62	5.68	7.10	8.52	9.94
75/142*	0.1750	5.25	7.00	8.75	10.50	12.25
75/162 PLUS	0.1616	4.85	6.46	8.08	9.70	11.31
90/162	0.2057	6.17	8.23	10.29	12.34	14.40
90/182 PLUS	0.1747	5.24	6.99	8.74	10.48	12.23
110/162	0.2957	8.87	11.83	14.79	17.74	20.70
110/182	0.2355	7.07	9.42	11.78	14.13	16.49
110/202 PLUS	0.1992	5.98	7.97	9.96	11.95	13.94
125/182	0.3026	9.08	12.10	15.13	18.16	21.18
125/202 PLUS	0.2771	8.31	11.08	13.86	16.63	19.40
140/202	0.3084	9.25	12.34	15.42	18.50	21.59
160/250**	0.3028	9.08	12.11	15.14	18.17	21.20

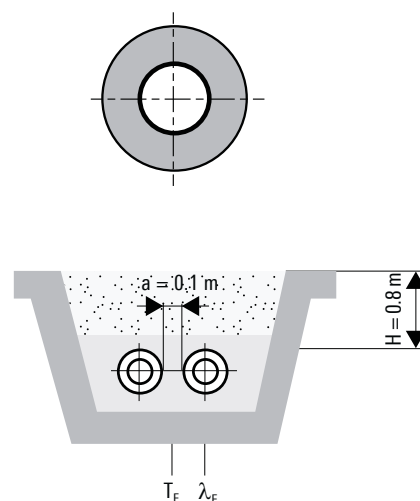

## CALPEX / CALPEX PUR-KING DUO

(flow and return in one pipe)

Heat losses q [W/m] for one DUO pipe						
CALPEX DUO	U-value [W/mK]	Average operating temperature $T_B$ [°C]				
		40°	50°	60°	70°	80°
25 + 25/ 91*	0.1635	4.91	6.54	8.18	9.81	11.45
25 + 25/111 PLUS*	0.1285	3.86	5.14	6.43	7.71	9.00
32 + 32/111*	0.1690	5.07	6.76	8.45	10.14	11.83
32 + 32/126 PLUS*	0.1431	4.29	5.72	7.16	8.59	10.02
40 + 40/126*	0.1909	5.73	7.64	9.55	11.45	13.36
40 + 40/142 PLUS*	0.1594	4.78	6.38	7.97	9.56	11.16
50 + 50/162	0.1954	5.86	7.82	9.77	11.72	13.68
50 + 50/182 PLUS	0.1662	4.99	6.65	8.31	9.97	11.63
63 + 63/182	0.2381	7.14	9.52	11.91	14.29	16.67
63 + 63/202 PLUS	0.2075	6.23	8.30	10.38	12.45	14.53
75+75/202	0.2802	8.41	11.21	14.01	16.81	19.61

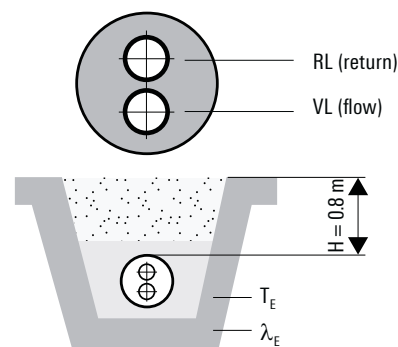

- Type of installation, CPX UNO: 2-pipe, laid in the ground
- Type of installation, CPX DUO: 1-pipe, laid in the ground
- Pipe distance:  $a = 0.10$  m
- Cover above pipe:  $H = 0.80$  m
- Ground temperature:  $T_E = 10$  °C
- Soil conductivity:  $\lambda_E = 1.0$  W/mK
- \* Conductivity of PUR-KING foam:  $\lambda_{PU} = 0.0199$  W/mK
- Conductivity of PUR foam:  $\lambda_{PU} = 0.0216$  W/mK
- \*\* Conductivity of PUR foam:  $\lambda_{PU} = 0.0260$  W/mK
- Conductivity of PEX pipe:  $\lambda_{PEXa} = 0.38$  W/mK
- Conductivity of PE pipe:  $\lambda_{PE} = 0.33$  W/mK

### Heat loss during operation:


- $q = U (T_B - T_E)$  [W/m]
- $U$  = Heat transfer coefficient [W/mK]
- $T_B$  = Average operating temperature [°C]
- $T_E$  = Average ground temperature [°C]
- VL = Flow
- RL = Return

# Heat loss

Sanitary, 10 bar


## CALPEX UNO

Heat losses q [W/m] for one UNO pipe						
CALPEX UNO	U-value [W/mK]	Average operating temperature $T_B$ [°C]				
		40°	50°	60°	70°	80°
22/ 76	0.1131	3.39	4.52	5.66	6.79	7.92
28/ 76	0.1387	4.16	5.55	6.94	8.32	9.71
32/ 76	0.1588	4.76	6.35	7.94	9.53	11.12
40/ 91	0.1666	5.00	6.66	8.33	10.00	11.66
50/111	0.1713	5.14	6.85	8.57	10.28	11.99
63/126	0.1957	5.87	7.83	9.79	11.74	13.70
32/111 HBK	0.1127	3.38	4.51	5.64	6.76	7.89
40/126 HBK	0.1220	3.66	4.88	6.10	7.32	8.54
50/126 HBK	0.1497	4.49	5.99	7.49	8.98	10.48

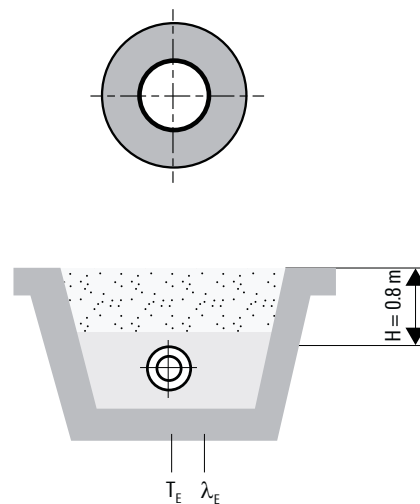

## CALPEX DUO

Heat losses q [W/m] for one DUO pipe						
CALPEX DUO	U-value [W/mK]	Average operating temperature $T_B$ [°C]				
		40°	50°	60°	70°	80°
28 + 22/91	0.1956	5.87	7.82	9.78	11.74	13.69
32 + 22/111	0.1677	5.03	6.71	8.39	10.06	11.74
40 + 28/126	0.1878	5.63	7.51	9.39	11.27	13.15
50 + 32/126	0.2476	7.43	9.90	12.38	14.86	17.33

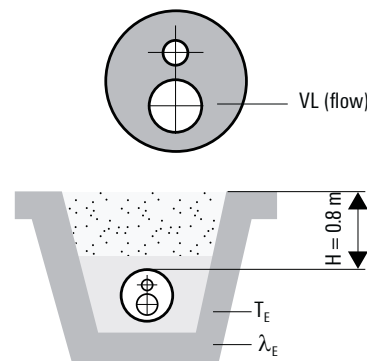

Type of installation, CPX UNO: 1-pipe, laid in the ground  
 Type of installation, CPX DUO: 1-pipe, laid in the ground  
 Cover above pipe:  $H = 0.80$  m  
 Ground temperature:  $T_E = 10$  °C  
 Soil conductivity:  $\lambda_E = 1.0$  W/mK  
 Conductivity of PUR foam:  $\lambda_{PU} = 0.0234$  W/mK  
 Conductivity of PEX pipe:  $\lambda_{PEXa} = 0.38$  W/mK  
 Conductivity of PE pipe:  $\lambda_{PE} = 0.33$  W/mK

### Heat loss during operation:


$q = U (T_B - T_E)$  [W/m]  
 $U$  = Heat transfer coefficient [W/mK]  
 $T_B$  = Average operating temperature [°C]  
 $T_E$  = Average ground temperature [°C]

# Heat loss

Heating 6 bar, sanitary 10 bar, QUADRIGA

## CALPEX QUADRIGA

Heat losses q [W/m] for one QUADRIGA pipe					
CALPEX QUADRIGA	U-value [W/mK]	Average operating temperature T <sub>B</sub> [°C]			
		50°	55°	60°	65°
H 25 + 25/S 28 + 22/142	0.159	6.34	7.13	7.93	8.72
H 32 + 32/S 28 + 22/142	0.184	7.34	8.26	9.18	10.10
H 32 + 32/S 32 + 22/142	0.199	7.97	8.96	9.96	10.96
H 40 + 40/S 40 + 28/162	0.235	9.40	10.58	11.75	12.93

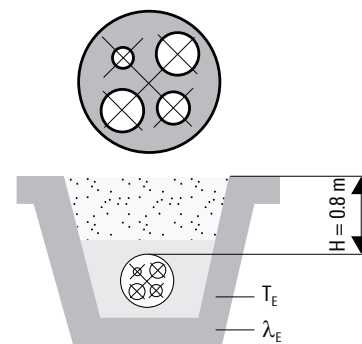

Type of installation for QUADRIGA: 1-pipe, laid in the ground

- Cover above pipe: H = 0.80 m
- Ground temperature: T<sub>E</sub> = 10 °C
- Soil conductivity: λ<sub>E</sub> = 1.0 W/mK
- Conductivity of PUR foam: λ<sub>PU</sub> = 0.0234 W/mK
- Conductivity of PEXa pipe: λ<sub>PEX</sub> = 0.38 W/mK
- Conductivity of PE pipe: λ<sub>PE</sub> = 0.33 W/mK

### Heat loss during operation:

- q = U (T<sub>B</sub> - T<sub>E</sub>) [W/m]
- U = Heat transfer coefficient [W/mK]
- T<sub>B</sub> = Average operating temperature [°C]
- T<sub>E</sub> = Average ground temperature [°C]

## CALPEX QUADRIGA - heat loss during operation

### Example of calculation for average operating temperature T<sub>B</sub> [°C]

- Flow - heating: 70 °C
- Return - heating: 40 °C
- Flow - sanitary: 60 °C
- Return - sanitary: 50 °C

$$T_B = \frac{70^\circ + 40^\circ + 60^\circ + 50^\circ}{4} = 55^\circ\text{C}$$

# Planning and connection technology

Heating strip, sanitary, 10 bar

## 1. Requirements for heating strip

### 1.1 Minimum power

Type CALPEX UNO	In relation to a maintained temperature of:		
	40 °C	50 °C	60 °C
32/111	5.8 W/m	7.8 W/m	9.6 W/m
40/126	6.3 W/m	8.3 W/m	10.4 W/m
50/126	7.3 W/m	10.3 W/m	12.8 W/m

### 1.2 Recommendations for heating strip

#### Hot water:

HWAT-R from Tyco Thermal Controls N.V. meets the requirement for Ø 50/126, 60 °C  
Automatic power adjustment with HWAT-ECO



#### Frost protection:

FS-B-2X from Tyco Thermal Controls N.V. requires thermostat with temperature sensor, UTR15



Max. heating circuit length in relation to a cut-in temperature of 12 °C (HWAT) or 0 °C (FS-B-2X)		
Heating strip type	Fuse	Length Lmax
HWAT-R	13 A	60 m
	16 A	80 m
	20 A	100 m
FS-B-2X	10 A	65 m
	16 A	105 m

### Fuse protection using automatic cutouts with characteristic C

## 2. Joint

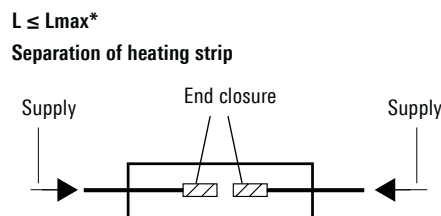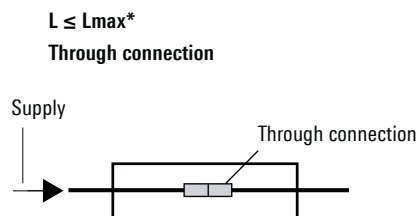

## 3. T-branch

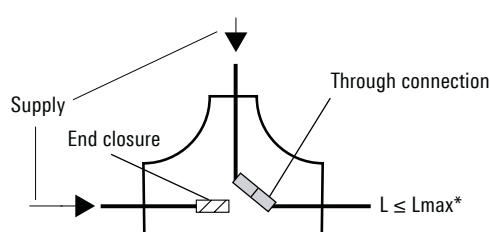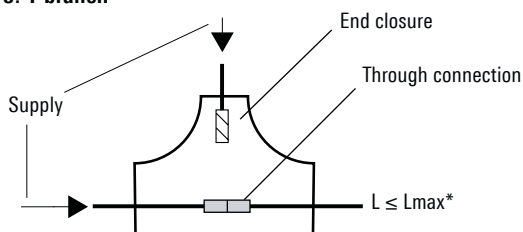

For the T-branch, note that the sum of two connected pipes must not be  $> L_{max}^*$ . T-switches **cannot** be supplied.

\*  $L_{max}$  = max. permitted length for heating strip

**The heating strip and the accessories are installed by the electrician!**



# House entry bend, 90°

Heating 6 bar, UNO

Bend, 90° delivered without press fittings

Dimensions: CPX 25/76 - 125/182\*  
CPX 160/250\*\*

Bend, 90° DN 150 (St 37.0) with welded-on press fittings  
Dimensions: CPX 140/202 - Carrier pipe P235

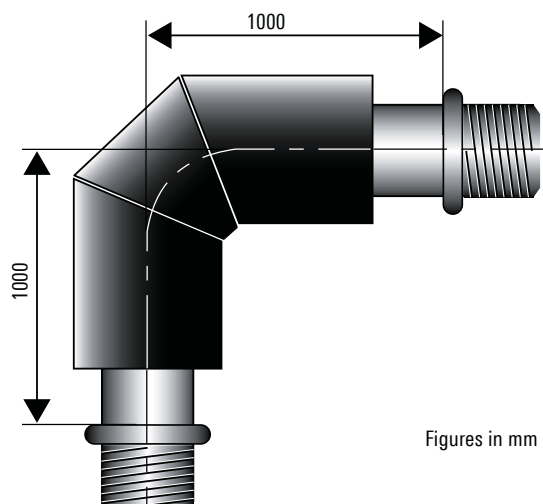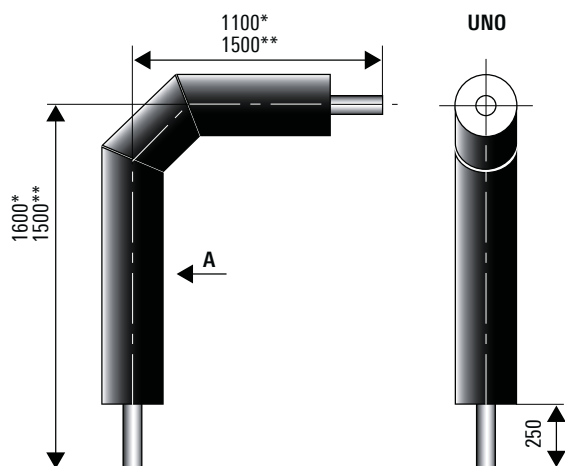

Figures in mm

## CALPEX UNO

Type	PEX carrier pipe d x s mm	Outer casing D x s1 mm	Volume carrier pipe l/m	Weight kg/unit
25/ 76	25 x 2.3	75 x 2.9	0.32	2.30
25/ 91 PLUS	25 x 2.3	90 x 3.5	0.32	-
32/ 76	32 x 2.9	75 x 2.9	0.53	2.50
32/ 91 PLUS	32 x 2.9	90 x 3.5	0.53	-
40/ 91	40 x 3.7	90 x 3.5	0.83	3.47
40/111 PLUS	40 x 3.7	110 x 4.3	0.83	-
50/111	50 x 4.6	110 x 4.3	1.30	4.92
50/126 PLUS	50 x 4.6	125 x 4.9	1.30	-
63/126	63 x 5.8	125 x 4.9	2.07	6.50
63/142 PLUS	63 x 5.8	140 x 4.4	2.07	-
75/142	75 x 6.8	140 x 4.4	2.96	8.47
75/162 PLUS	75 x 6.8	160 x 5.0	2.96	-
90/162	90 x 8.2	160 x 5.0	4.25	11.40
90/182 PLUS	90 x 8.2	180 x 5.6	4.25	-
110/162	110 x 10.0	160 x 5.0	6.36	14.23
110/182	110 x 10.0	180 x 5.6	6.36	16.19
110/202 PLUS	110 x 10.0	200 x 6.2	6.36	-
125/182	125 x 11.4	180 x 5.6	8.20	17.20
125/202 PLUS	125 x 11.4	200 x 6.2	8.20	-
140/225	140 x 12.7	225 x 6.9	13.79	40.95
160/250	160 x 14.6	250 x 6.2	20.18	58.40

Connection with press connections (for coupling, see CPX 1.390)

Supplementary insulation ≤ Ø 182 mm with CPX clip shells (for CPX-I shell, see CPX 1.325/1.326) or ≥ Ø 202 mm with shrink-on sleeves (see CPX 1.320)




# House entry bend 90°

Heating 6 bar, DUO

Bend 90° delivered without press fittings

Dimensions: CPX 25/25/91 - 75+75/202

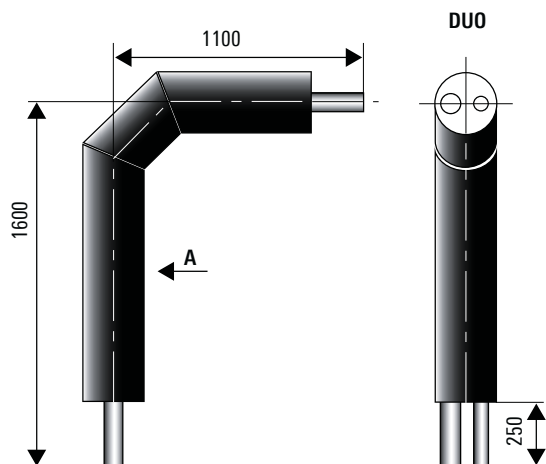

Figures in mm

## CALPEX DUO

Type	PEX carrier pipe d x s mm	Outer casing D x s1 mm	Volume carrier pipe l/m	Weight kg/unit
25 + 25/ 91	2 x 25 x 2.3	90 x 3.5	2 x 0.32	4.32
25 + 25/111 PLUS	2 x 25 x 2.3	110 x 4.3	2 x 0.32	-
32 + 32/111	2 x 32 x 2.9	110 x 4.3	2 x 0.53	4.67
32 + 32/126 PLUS	2 x 32 x 2.9	125 x 4.9	2 x 0.53	-
40 + 40/126	2 x 40 x 3.7	125 x 4.9	2 x 0.83	7.42
40 + 40/142 PLUS	2 x 40 x 3.7	140 x 4.3	2 x 0.83	-
50 + 50/162	2 x 50 x 4.6	160 x 5.0	2 x 1.30	9.90
50 + 50/182 PLUS	2 x 50 x 4.6	180 x 5.6	2 x 1.30	-
63 + 63/182	2 x 63 x 5.8	180 x 5.6	2 x 2.07	13.96
63 + 63/202 PLUS	2 x 63 x 5.8	200 x 6.2	2 x 2.07	-
75 + 75/202	2 x 75 x 6.8	200 x 6.2	2 x 2.96	-

Connection with press connections (for coupling, see CPX 1.390)


Supplementary insulation ≤ Ø 182 mm with CPX clip shells (for CPX-I shell, see CPX 1.325/1.326) or ≥ Ø 202 mm with shrink-on sleeves (see CPX 1.320)

# House entry bend, 90°

Sanitary, 10 bar, UNO and DUO

Bend, 90° delivered without press fittings

Dimensions: CPX 22/76 - 63/126

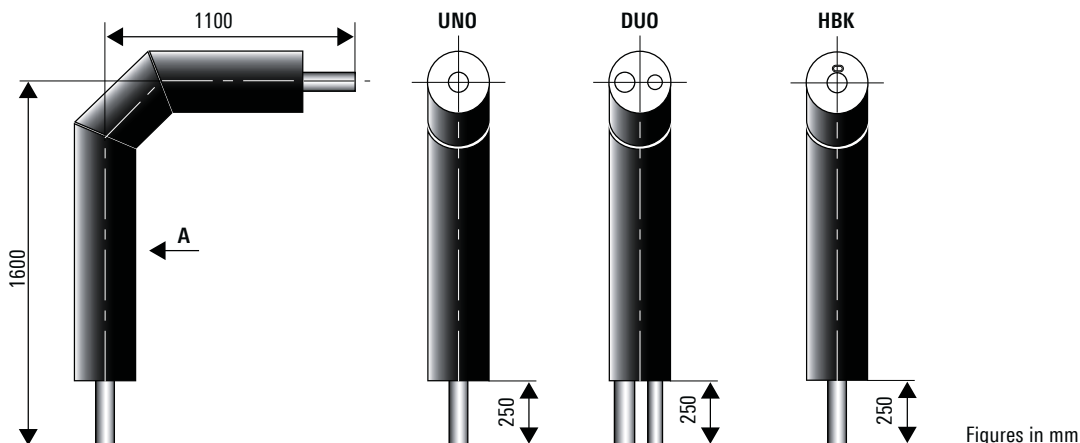

Figures in mm

## CALPEX UNO

Type	DN	Inches	PEX carrier pipe d x s mm	Outer casing D x s1 mm	Volume carrier pipe l/m	Weight kg/unit
22/ 76	16	5/8	22 x 3.0	75 x 2.9	0.20	2.40
28/ 76	20	3/4	28 x 4.0	75 x 2.9	0.31	2.65
32/ 76	25	1	32 x 4.4	75 x 2.9	0.42	2.80
40/ 91	32	1 1/4	40 x 5.5	90 x 3.5	0.66	3.90
50/111	40	1 1/2	50 x 6.9	110 x 4.3	1.02	5.62
63/126	50	2	63 x 8.7	125 x 4.9	1.63	7.65
32/111 HBK	25	1	32 x 4.4	110 x 4.3	0.42	6.53
40/126 HBK	32	1 1/4	40 x 5.5	125 x 4.9	0.66	8.56
50/126 HBK	40	1 1/2	50 x 6.9	125 x 4.9	1.02	9.38

## CALPEX DUO

Type	DN	Inches	PEX carrier pipe d x s mm	Outer casing D x s1 mm	Volume carrier pipe l/m	Weight kg/unit
28 + 22/ 91	20 + 16	3/4 + 5/8	28.0 x 4.0 + 22.0 x 3.0	90 x 3.5	0.31 + 0.20	3.67
32 + 22/111	25 + 16	1 + 5/8	32.0 x 4.4 + 22.0 x 3.0	110 x 4.3	0.42 + 0.20	4.87
40 + 28/126	32 + 20	1 1/4 + 3/4	40.0 x 5.5 + 28.0 x 4.0	125 x 4.9	0.66 + 0.31	6.50
50 + 32/126	40 + 25	1 1/2 + 1	50.0 x 6.9 + 32.0 x 4.4	125 x 4.9	1.02 + 0.42	7.30


Connection with press connections (for coupling, see CPX 1.390)

Supplementary insulation with CPX clip shells (for CPX-I shell, see CPX 1.325/1.326) or with shrink-on sleeves (see CPX 1.320)

# House entry bend, 90°

Heating 6 bar, sanitary 10 bar, QUADRIGA

Bend, 90° DN 16 - DN 32

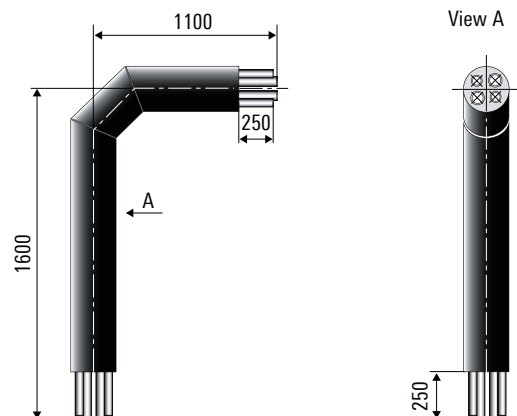

Figures in mm

## CALPEX QUADRIGA


Type	DN	Inches	PEX carrier pipe d x s mm	Outer casing D x s1 mm	Volume carrier pipe l/m	Weight kg/unit
H25+25/S28+22/142	20	¾	25 x 2.3	140 x 4.4	0.327	8.12
	20	¾	25 x 2.3		0.327	
	20	¾	28 x 4.0		0.314	
	16	⅝	22 x 3.0		0.201	
H32+32/S28+22/142	25	1	32 x 2.9	140 x 4.4	0.539	8.47
	25	1	32 x 2.9		0.539	
	20	¾	28 x 4.0		0.314	
	16	⅝	22 x 3.0		0.201	
H32+32/S32+22/142	25	1	32 x 2.9	140 x 4.4	0.539	8.52
	25	1	32 x 2.9		0.539	
	25	1	32 x 4.4		0.423	
	16	⅝	22 x 3.0		0.201	
H40+40/S40+28/162	32	1¼	40 x 3.7	160 x 5.0	0.835	10.37
	32	1¼	40 x 3.7		0.835	
	32	1¼	40 x 5.5		0.660	
	20	¾	28 x 4.0		0.314	

Connection with press connections (for coupling, see CPX 1.390)

Supplementary insulation with shrink-on sleeves (see CPX 1.320)

# CALPEX L-shell

Dimensions Ø 76 - 126 mm

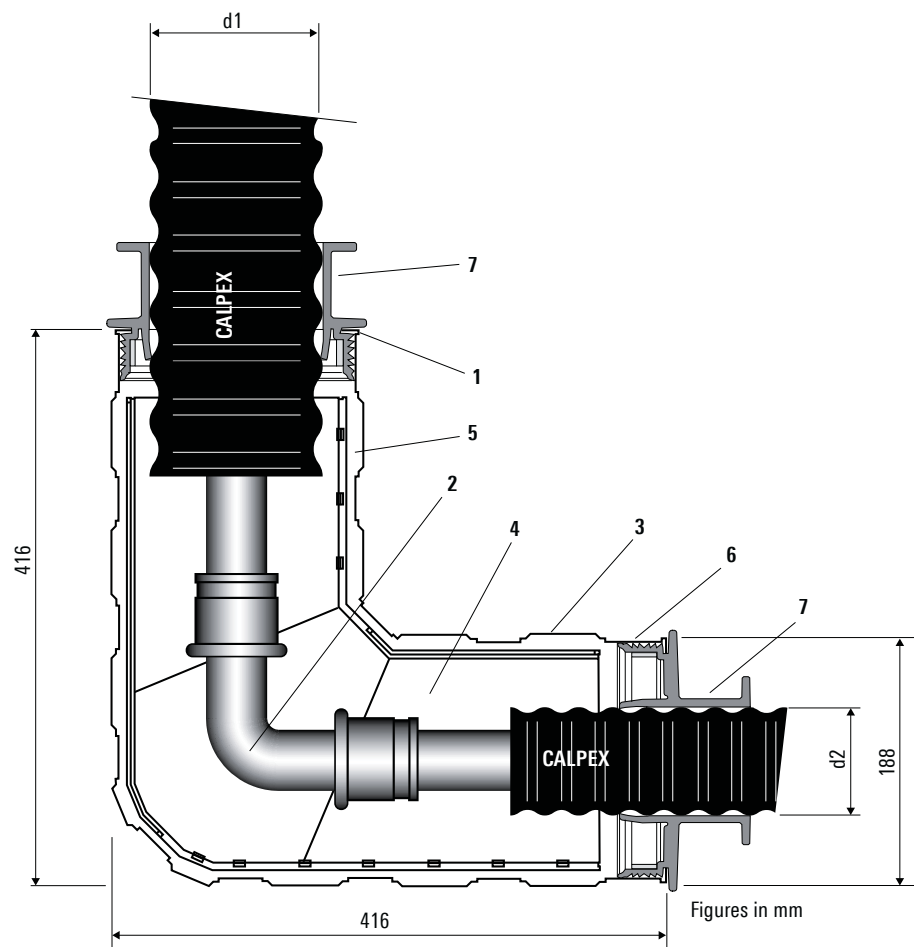

## CALPEX L-shell, UNO/DUO

Outer casing Ø d1	Ø d2			
	76	91	111	126
76	x			
91		x		
111			x	
126				x

**Note: CALPEX shells are not suggested to be installed UV exposed!**


CALPEX shells are not suitable for use with CALPEX QUADRIGA (distribution chamber: see CPX 1.350).

## Structure of the half-shell

- 1 ABS half-shells
- 2 PEX angle coupling; see CPX 1.390
- 3 Sealing clamps (15 pcs.)
- 4 Insulation material; see CPX 1.365
- 5 Glued surface
- 6 Reduction ring or sealing ring
- 7 Hose clip

# CALPEX Big L-shell

Dimensions Ø 142 - 182 mm

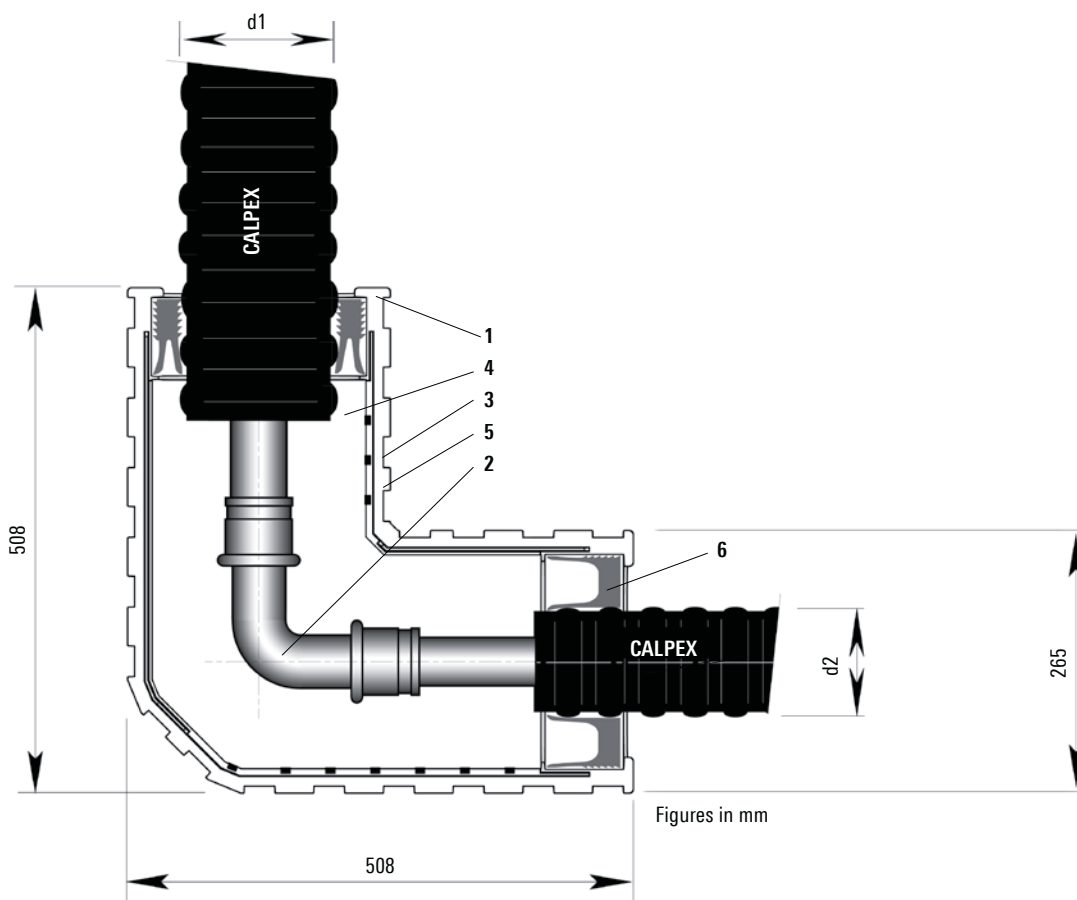

## CALPEX Big L-shell, UNO/DUO

Outer casing Ø d1	Ø d2		
	142	162	182
142	x		
162		x	
182			x

**Note: CALPEX shells are not suggested to be installed UV exposed!**

CALPEX shells are not suitable for use with CALPEX QUADRIGA (distribution chamber: see CPX 1.350).

CALPEX Big-shells are freely reducible from Ø 182 mm to Ø 76 mm


## Structure of the half-shell

- 1 ABS half-shells
- 2 PEX angle coupling; see CPX 1.390
- 3 Sealing clamps (22 pcs.)
- 4 Insulation material; see CPX 1.365
- 5 Glued surface
- 6 Reduction ring or sealing ring


# Joint using PE-HD shrink sleeve

Dimensions Ø 76 - 250 mm


CALPEX joint

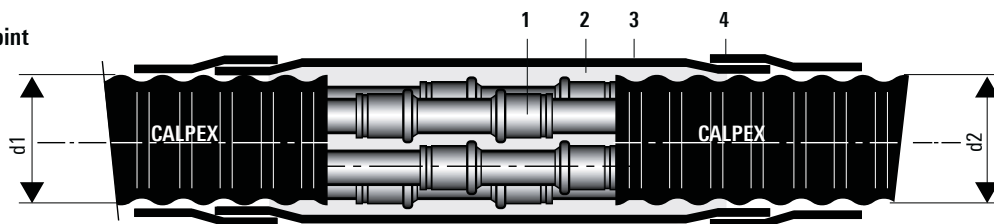

CALPEX reduction joint

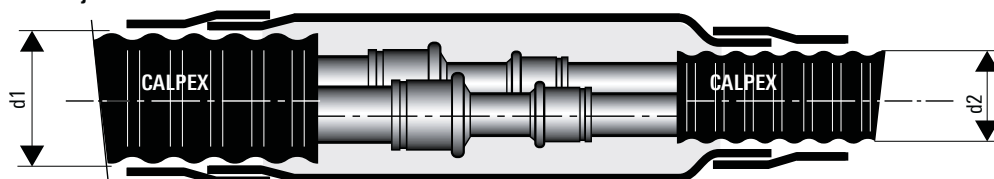


CALPEX – Insulated steel pipe

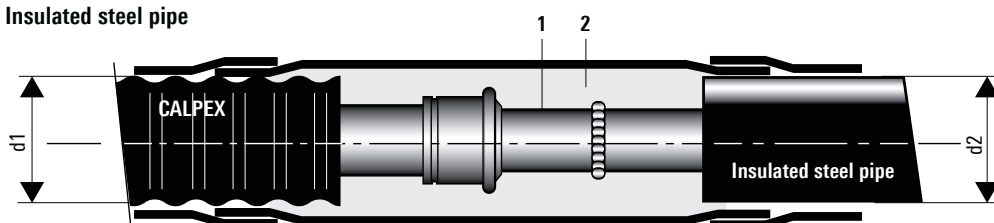

- 1 PEX coupling; see sheet 1.390
- 2 Insulation material, PUR or PE; see sheet 1.365
- 3 Shrink sleeve pipe
- 4 Shrink hose

**Installation note:**

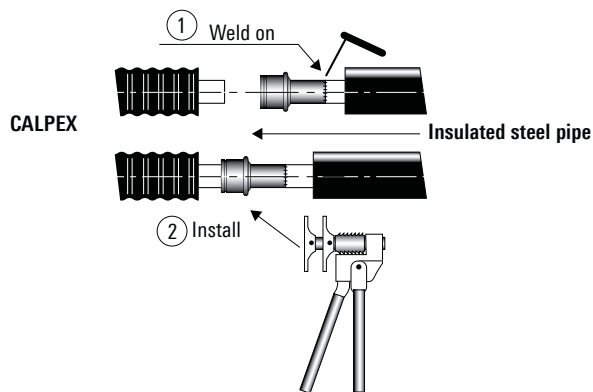

**CALPEX-CALPEX**


	Ø d2	76	91	111	126	142	162	182	250
Ø d1	76	x	x						
	91		x	x					
	111			x	x				
	126				x	x			
	142					x	x		
	162						x	x	
	182							x	x
	250								x

**CALPEX to insulated steel pipe**

	Ø d2	90	110	125	140	160	180	200	225	250	280	315
Ø d1	76	x	x	x								
	91	x	x	x	x							
	111	x	x	x	x							
	126		x	x	x	x						
	142			x	x	x	x					
	162				x	x	x	x				
	182					x	x	x	x	x		
	250										x	x

# CALPEX I-shell

Dimensions Ø 76 - 126 mm

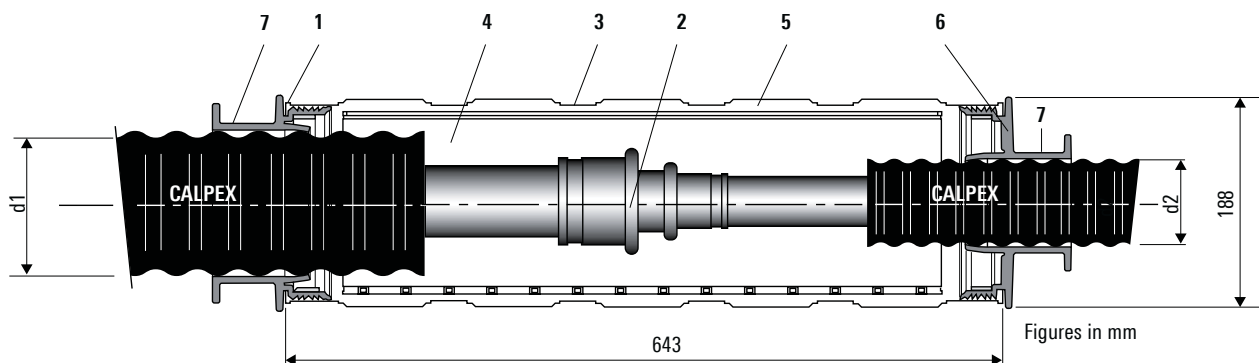

## CALPEX I-shell, UNO/DUO

Outer casing Ø d1	Ø d2			
	76	91	111	126
76	x			
91	x	x		
111	x	x	x	
126	x	x	x	x

**Note: CALPEX shells are not suggested to be installed UV exposed!**


CALPEX shells are not suitable for use with CALPEX QUADRIGA (distribution chamber: see CPX 1.350).

## Structure of the half-shell

- 1 ABS half-shells
- 2 PEX coupling; see CPX 1.390
- 3 Sealing clamps (14 pcs.)
- 4 Insulation material; see CPX 1.365
- 5 Glued surface
- 6 Reduction ring or sealing ring
- 7 Hose clip

# CALPEX Big I-shell

Dimensions Ø 142 - 182 mm

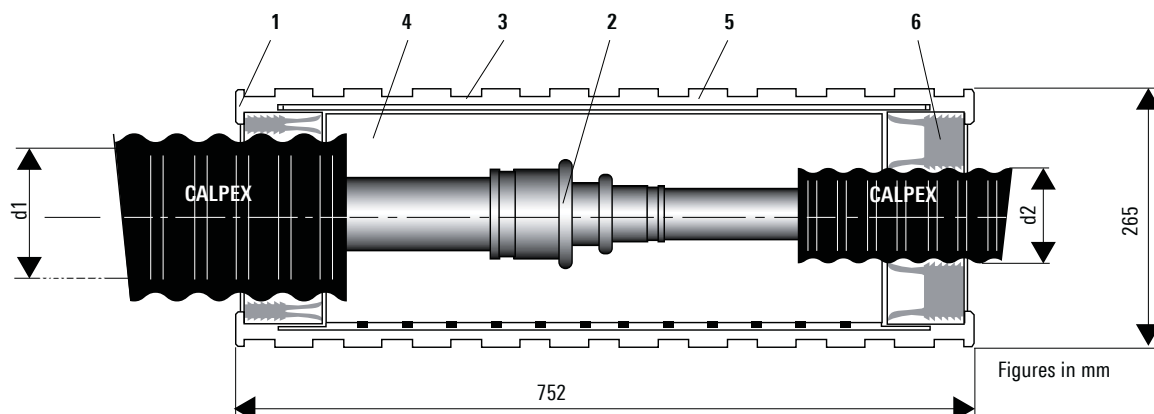

## CALPEX Big I-shell, UNO/DUO/QUADRIGA

Outer casing Ø d1	Ø d2		
	142	162	182
142	x		
162	x	x	
182	x	x	x

**Note:** CALPEX shells are not suggested to be installed UV exposed!

Distribution chamber: see CPX 1.350

CALPEX Big-shells are freely reducible from Ø 182 mm to Ø 76 mm


## Structure of the half-shell

- 1 ABS half-shells
- 2 PEX coupling; see CPX 1.390
- 3 Sealing clamps (22 pcs.)
- 4 Insulation material; see CPX 1.365
- 5 Glued surface
- 6 Reduction ring or sealing ring



# CALPEX T-shell

Dimensions Ø 76 - 126 mm

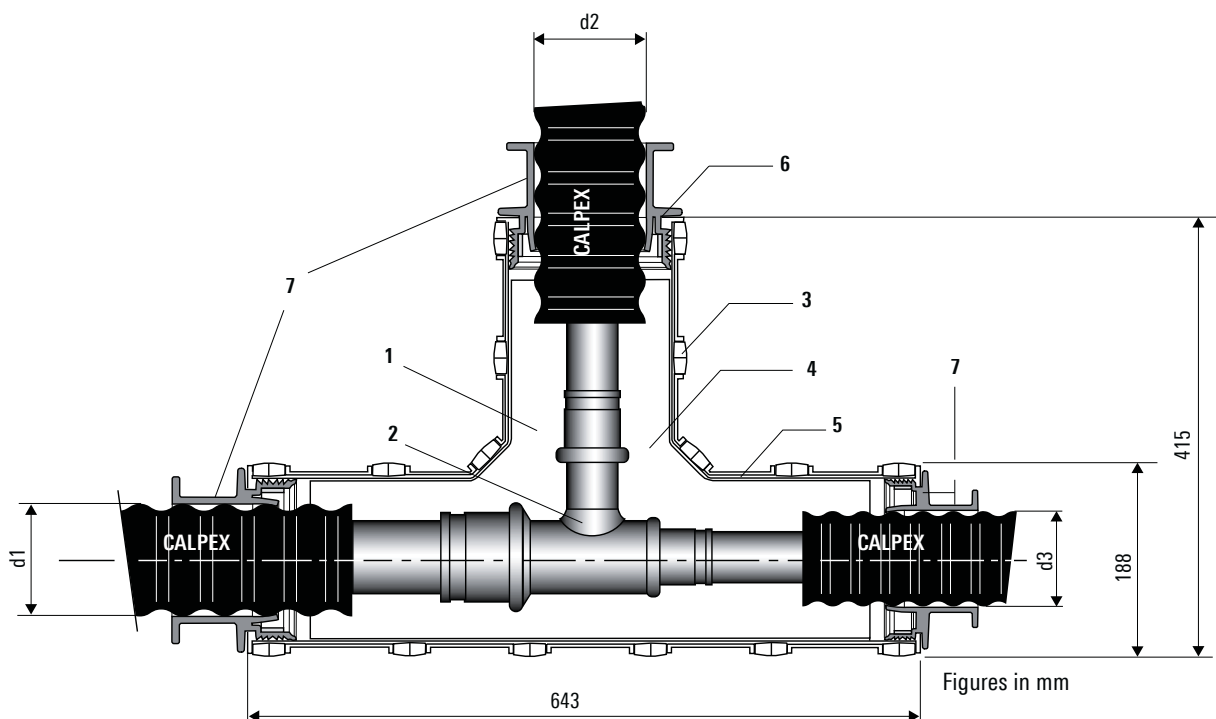

## CALPEX T-shell, UNO/DUO

Outer casing Ø d1 - Ø d3	Branch, Ø d2			
	76	91	111	126
76 - 76	x	x	x	x
91 - 91	x	x	x	x
91 - 76	x	x	x	x
111 - 111	x	x	x	x
111 - 91	x	x	x	x
111 - 76	x	x	x	x
126 - 126	x	x	x	x
126 - 111	x	x	x	x
126 - 91	x	x	x	x
126 - 76	x	x	x	x

## Structure of the half-shell


- 1 ABS half-shells
- 2 PEX T-piece; see CPX 1.395
- 3 Sealing clamps (20 pcs.)
- 4 Insulation material; see CPX 1.365
- 5 Glued surface
- 6 Reduction ring or sealing ring
- 7 Hose clip

**Note: CALPEX shells are not suggested to be installed UV exposed!**

CALPEX shells are not suitable for use with CALPEX QUADRIGA (distribution chamber: see CPX 1.350).

# CALPEX Big T-shell

Dimensions Ø 76 - 182 mm

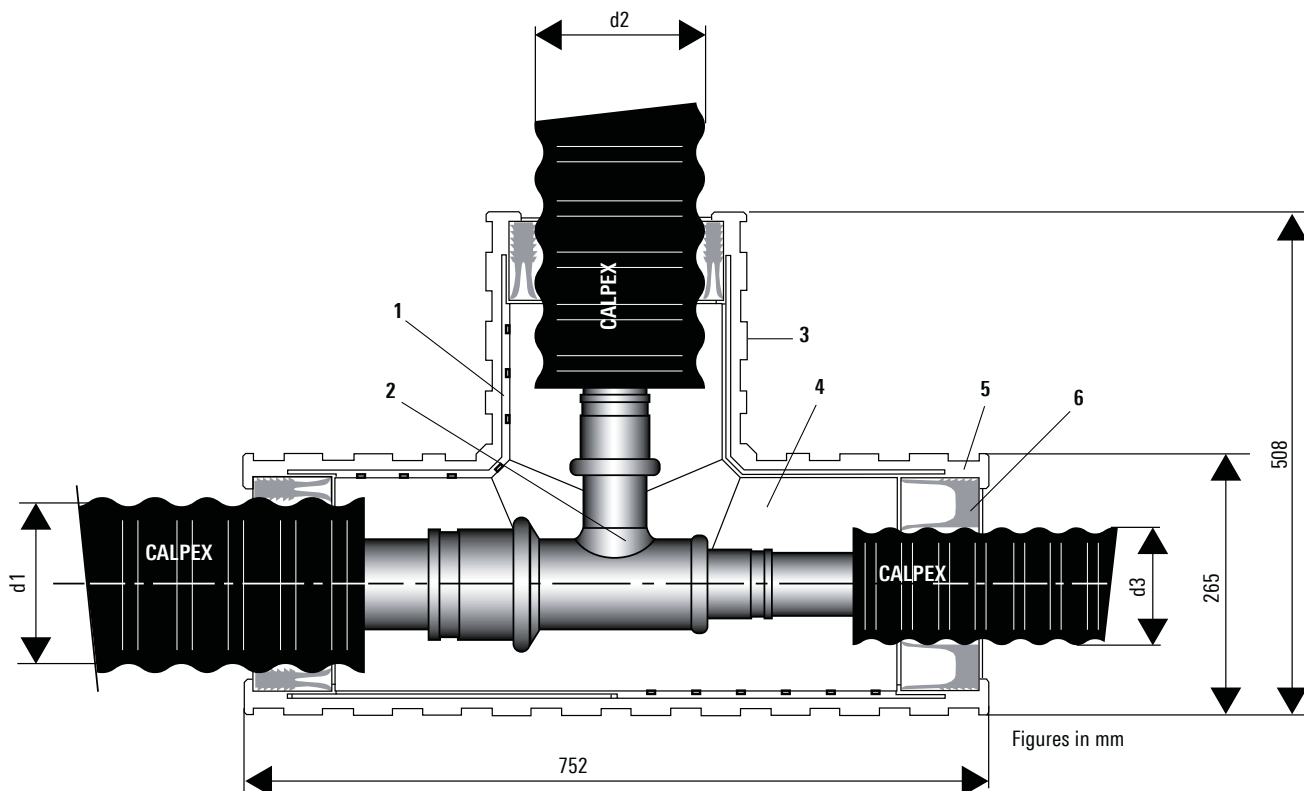

## CALPEX Big T-shell, UNO/DUO

Outer casing Ø d1 - Ø d3	Branch, Ø d2						
	76	91	111	126	142	162	182
142 - 142	x	x	x	x	x	x	x
142 - 126	x	x	x	x	x	x	x
142 - 111	x	x	x	x	x	x	x
142 - 91	x	x	x	x	x	x	x
142 - 76	x	x	x	x	x	x	x
162 - 162	x	x	x	x	x	x	x
162 - 142	x	x	x	x	x	x	x
162 - 126	x	x	x	x	x	x	x
162 - 111	x	x	x	x	x	x	x
162 - 91	x	x	x	x	x	x	x
162 - 76	x	x	x	x	x	x	x
182 - 182	x	x	x	x	x	x	x
182 - 162	x	x	x	x	x	x	x
182 - 142	x	x	x	x	x	x	x
182 - 126	x	x	x	x	x	x	x
182 - 111	x	x	x	x	x	x	x
182 - 91	x	x	x	x	x	x	x
182 - 76	x	x	x	x	x	x	x

## Structure of the half-shell

- 1 ABS half-shells
- 2 PEX T-piece; see CPX 1.395
- 3 Sealing clamps (27 pcs.)
- 4 Insulation material; see CPX 1.365
- 5 Glued surface
- 6 Reduction ring or sealing ring


**Note: CALPEX shells are not suggested to be installed UV exposed!**

CALPEX shells are not suitable for use with CALPEX QUADRIGA (distribution chamber: see CPX 1.350).

CALPEX Big-shells are freely reducible from Ø 182 mm to Ø 76 mm

# CALPEX-PE-T-Shell

Dimension Ø 202 mm

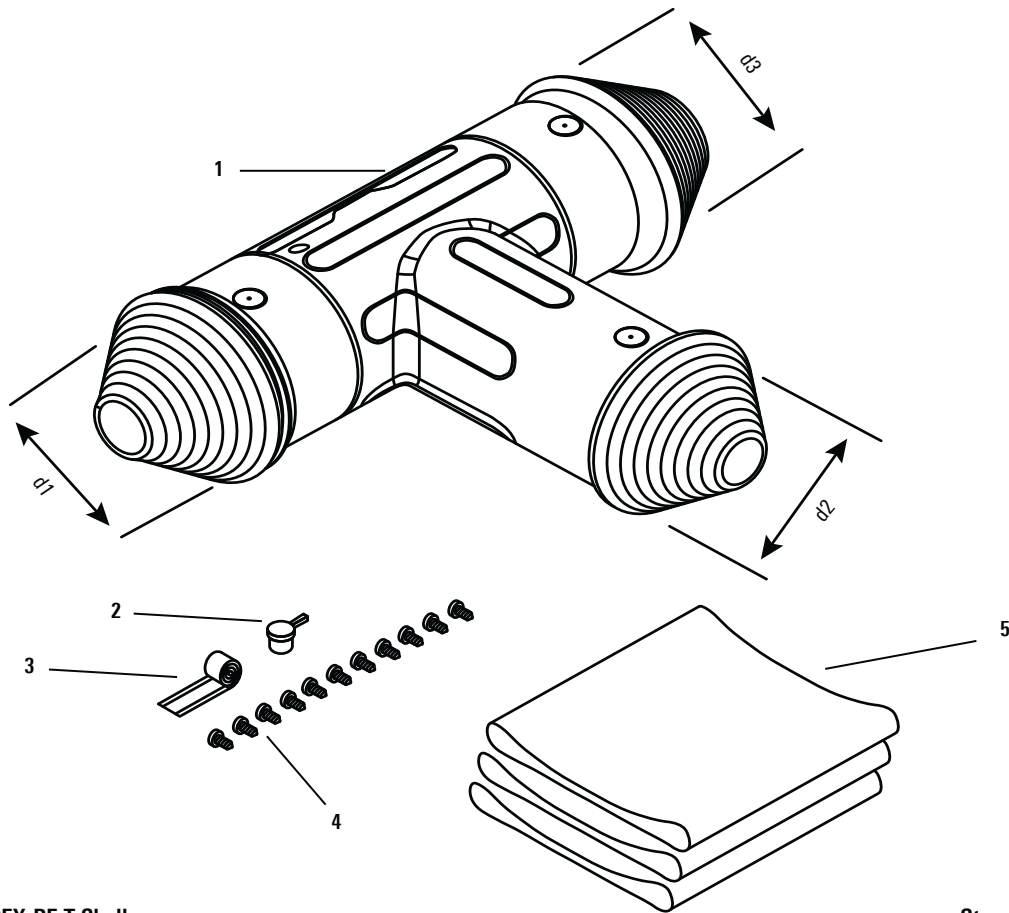

## CALPEX-PE-T-Shell


Outer casing Ø d1 - Ø d3	Branch, Ø d2						
	91	111	126	142	162	182	202
202 - 202	x	x	x	x	x	x	x
202 - 182	x	x	x	x	x	x	x
202 - 162	x	x	x	x	x	x	x
202 - 142	x	x	x	x	x	x	x
202 - 126	x	x	x	x	x	x	x
202 - 111	x	x	x	x	x	x	x
202 - 91	x	x	x	x	x	x	x

## Structure of the PE-Shell

- 1 PE-T-Shell
- 2 Sealing plug
- 3 Butyl sealing tape
- 4 Sealing screws
- 5 Heat-shrink sleeves

# T-joint


Dimension CPX 125/225 - 160/250

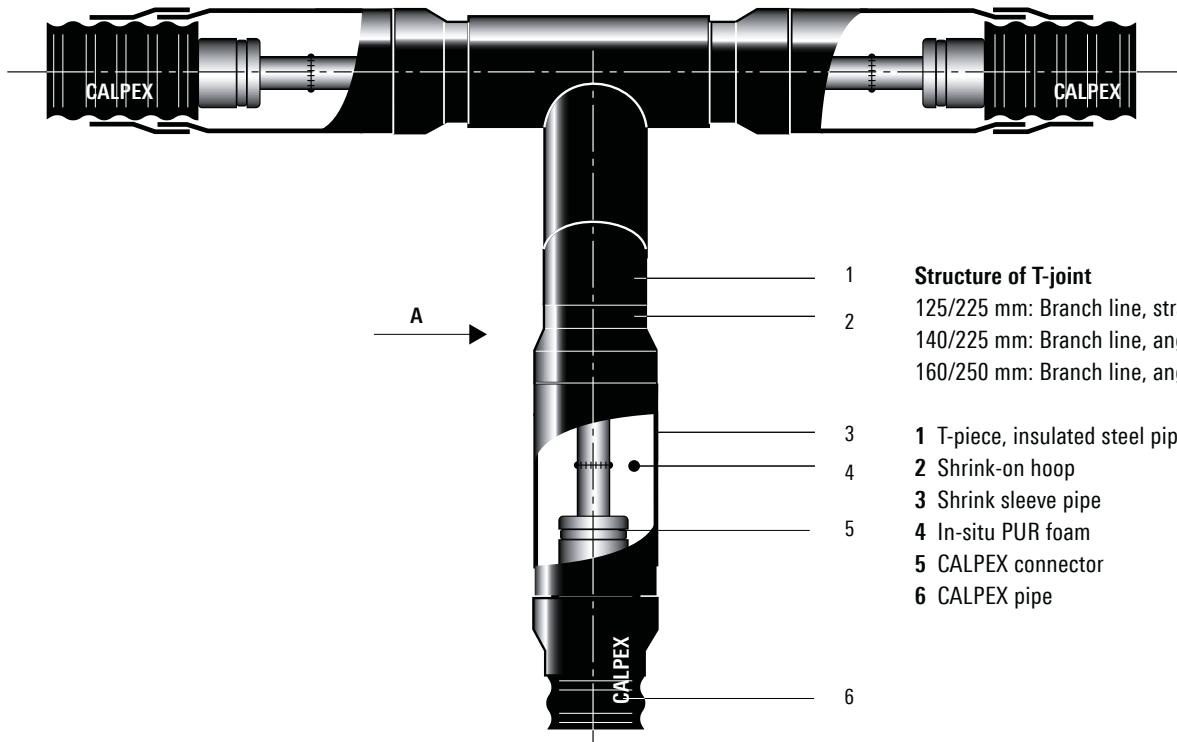

- Structure of T-joint**
- 125/225 mm: Branch line, straight
  - 140/225 mm: Branch line, angled 45°
  - 160/250 mm: Branch line, angled 45°
- 1 T-piece, insulated steel pipe (St 37.0)
  - 2 Shrink-on hoop
  - 3 Shrink sleeve pipe
  - 4 In-situ PUR foam
  - 5 CALPEX connector
  - 6 CALPEX pipe


CALPEX UNO (Ø 140, 160 mm)

View A

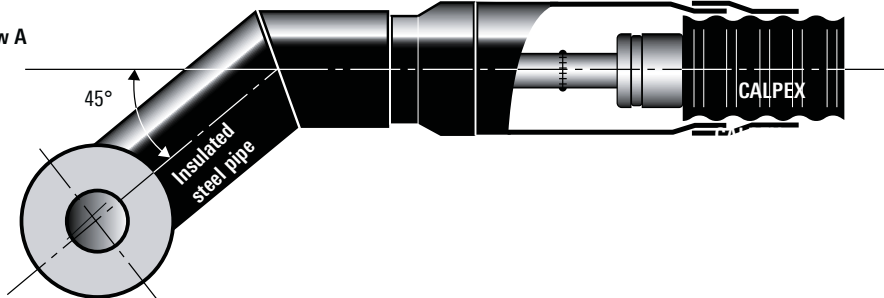

CALPEX UNO (Ø 125 mm) / CALPEX DUO (Ø 75 + 75 mm)

on request

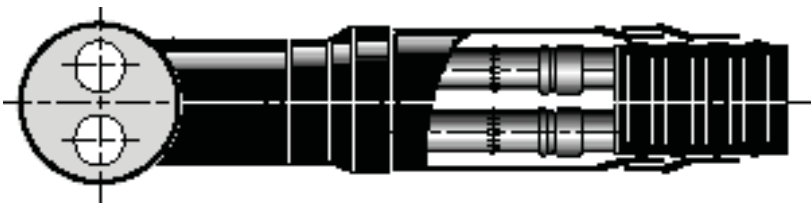

CALPEX T-joint



Outer casing Ø d1 Ø d3	Branch, Ø d2											
	25/76	32/76	40/91	50/111	63/126	75/142	90/162	110/162	110/182	125/182	140/225	160/250
125/225 - 125/225*	x	x	x	x	x	x	x	x	x	x	–	–
140/225 - 140/225*	x	x	x	x	x	x	x	x	x	x	x	–
160/250 - 160/250	x	x	x	x	x	x	x	x	x	x	x	x

\* Reduction sockets are required

We can supply T-pieces with different branches on request for CALPEX-UNO and DUO pipes

# Y-pipe

Heating, 6 bar

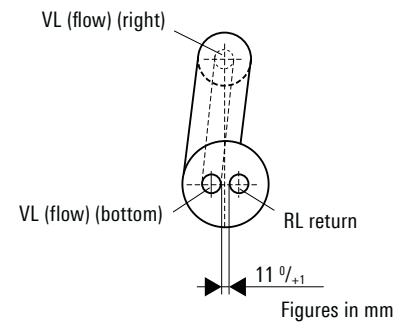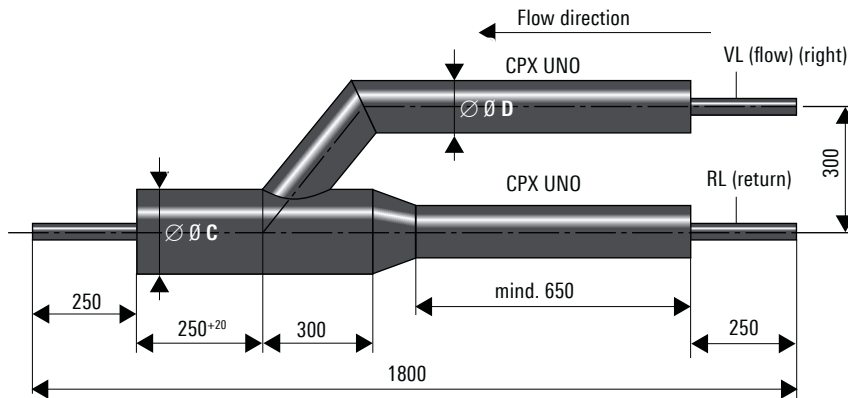

**View: A - A**

**Note:** With UNO pipe, in the direction of flow, the forward flow (VL) is always on the right and with DUO pipe, it is always at the bottom.

**CALPEX DUO / 2 x CALPEX UNO**

UNO pipes mm	Ø D mm	DUO CPX pipe mm	Ø C mm
2 x 25/ 76	75	25 + 25/ 91	90
2 x 25/ 91 PLUS	90	25 + 25/111	110
2 x 32/ 76	75	32 + 32/111	110
2 x 32/ 91 PLUS	90	32 + 32/126	125
2 x 40/ 91	90	40 + 40/126	125
2 x 40/111 PLUS	110	40 + 40/142	140
2 x 50/111	110	50 + 50/162	160
2 x 50/126 PLUS	125	50 + 50/182	180
2 x 63/126	125	63 + 63/182	180
2 x 63/142 PLUS	140	63 + 63/202	200
2 x 75/142	140	75 + 75/202	225*

\*Reduction sockets Ø 225/202 are required

PEXa carrier pipe – made of steel on request (P235 TR 1/GH)

Connection with press connections (for coupling, see CPX 1.390)









Supplementary insulation with CPX clip shells (for CPX-I shell, see CPX 1.325/1.326)

or with shrink-on sleeves (see CPX 1.320)



# Distribution chamber


Installation for dimensions CPX 25/76 - 125/182

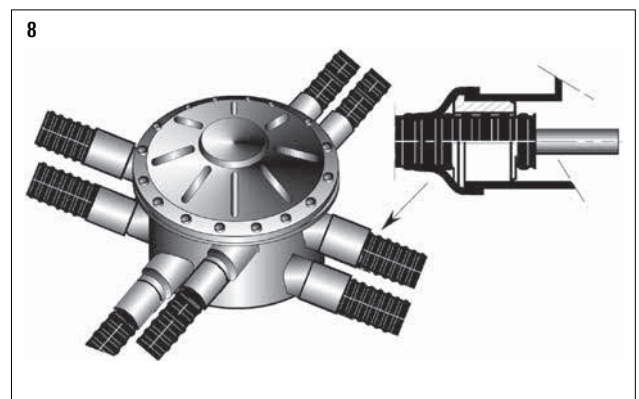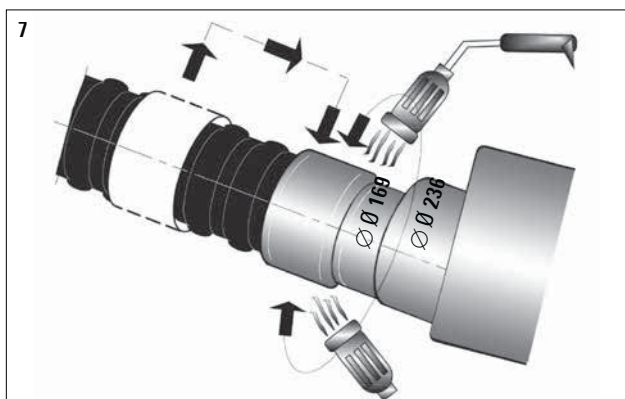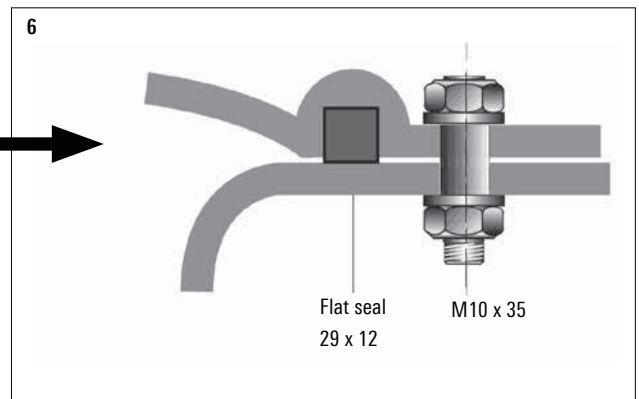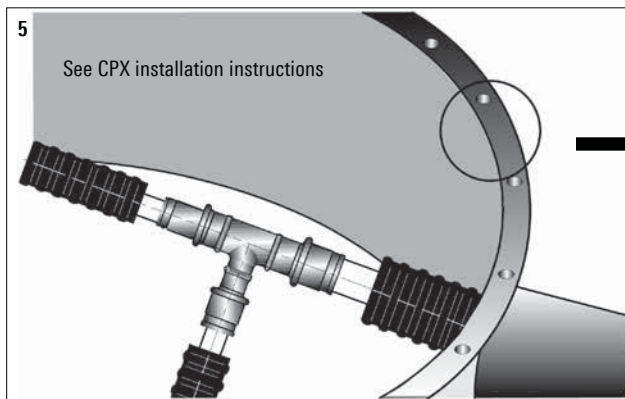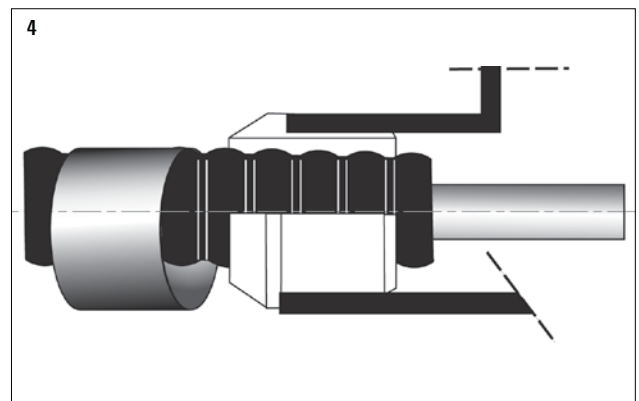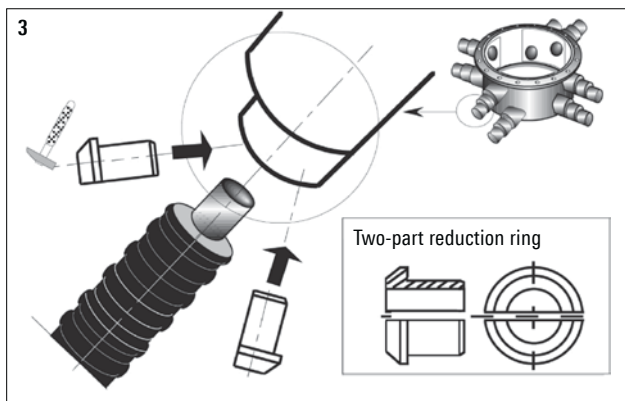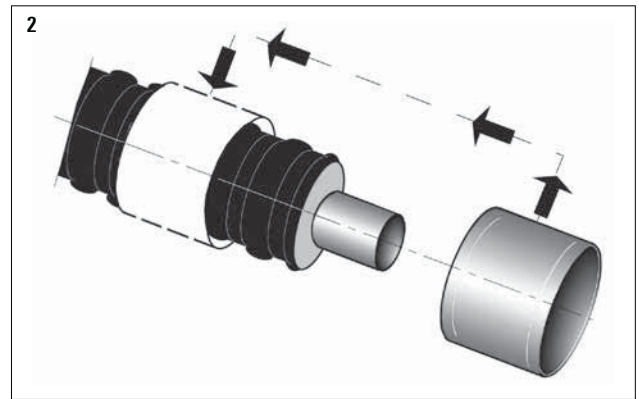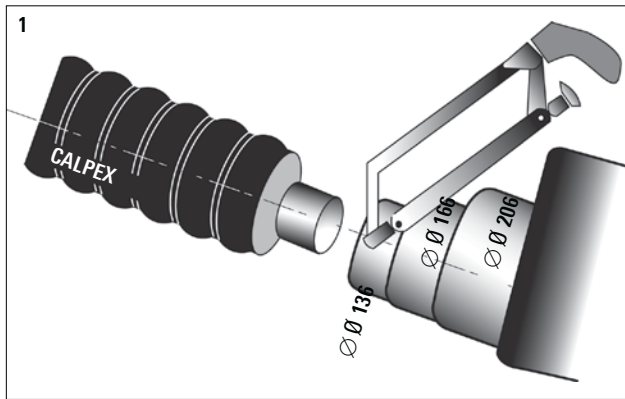

# Protective concrete plate

for distribution chamber

Schematic diagram showing installation of cover plate

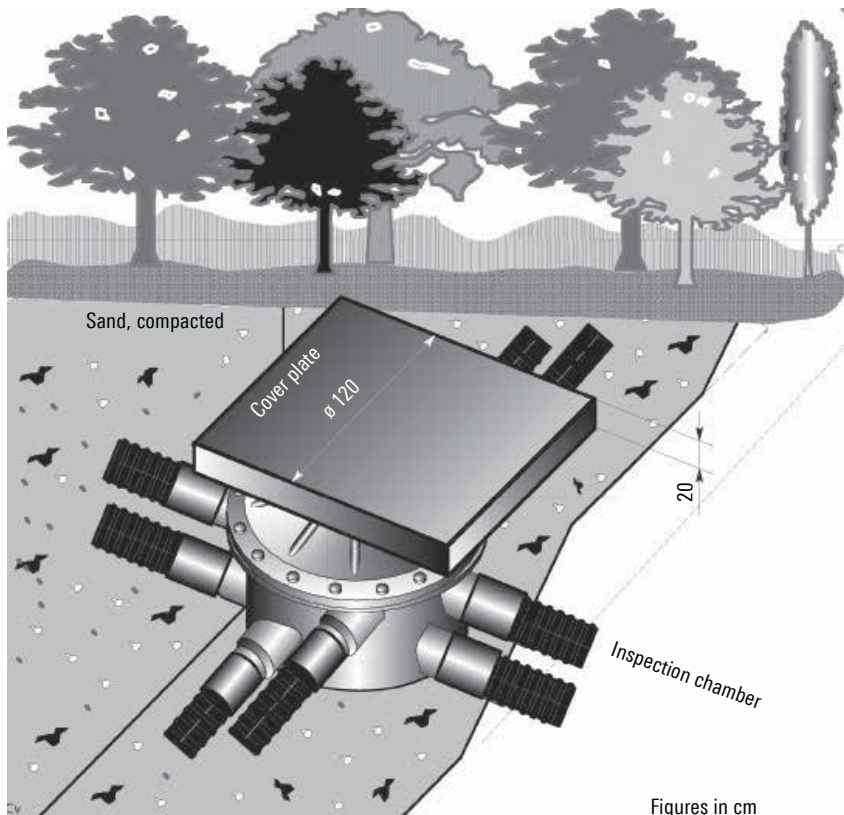

Figures in cm

**Load**

The cover plate has to be used wherever there might be public traffic and for low-depth installations. The maximum load per unit of area must not exceed  $q = 153 \text{ kN/m}^2$  (SLW 60 to DIN 1055).

**Installation method**

Correct installation of the sand must be ensured so that the plate can perform its function as a load shield for the inspection chamber. A Proctor density of  $dpr = 96\%$  should be the target for compaction. For subsequent work on the inspection chamber, the cover plate has lifting eyes. After completing the work and refilling the pit, make sure that the infill between the inspection chamber and concrete slabs is restored correctly.

**Filling/insulation material**

Some suggestions for filling and insulation materials that can be used are listed below:

- Bulk polystyrene material
- Armaflex or Tubolit
- Foam using BRAG PUR foam canister


**Note**

There is no need to use filling material in the distribution shaft. Likewise, it is not essential to insulate the pipes! The decision is up to the customer.


**Note**

The plate must be located so that it completely covers the chamber below (see illustration).



**Armouring**

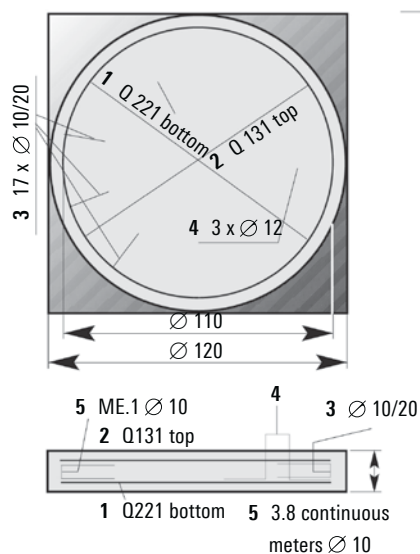

Figures in cm

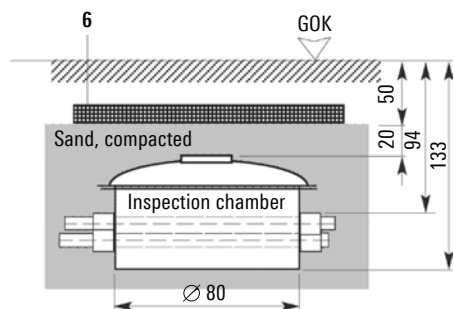

- 1 Q 221 bottom
- 2 Q 131 bottom
- 3 17 x Ø 10/20 mm (L = 0.5 m)  
Total length 8.5 m
- 4 3 x Ø 12 mm (L = 0.85 m)  
Total length 2.55 m





# Insulation material

PE foam (CPX 25/76 - 110/182), PUR foam container(s)

PUR foam bottles (CPX 25/76 - 160/250)


## Insulation material for shrink joints

### Polyethylene foam tube, (CPX 25/76 - 110/182)

Extruded pipe insulation made of closed-cell polyethylene, excellent for insulating CALPEX shrink joints (not for CALPEX shells). Various thicknesses of insulation are available for the most common pipe diameters.

The insulation material (thickness and length) is supplied for the relevant joint types.

The insulation must be fitted precisely into the joints on site.

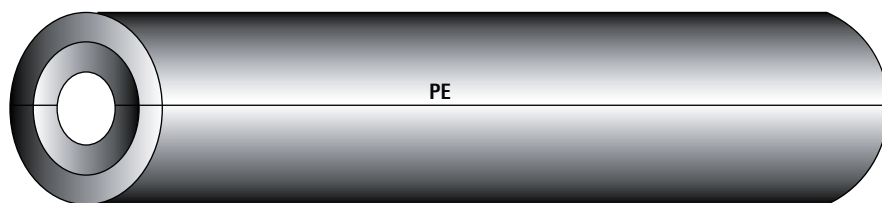

### PUR foam for shrink joints and CALPEX shells (CPX 25/76 - 160/250)

CFC-free, cyclopentane-blown PUR foam in plastic bottles


The required quantity of CFC-free polyurethane foam is delivered in suitable container sizes for the various joints and T-pieces. The components are supplied separately in two bottles and are only mixed together when needed. Please note the safety regulations in the installation instructions supplied with the product.



## Safety regulations

Protective goggles and gloves must be worn when using this product.

### Synthetic gloves

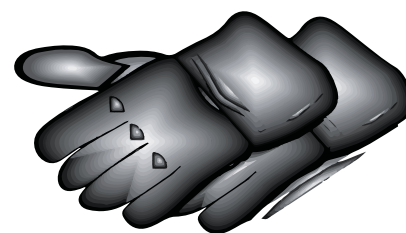


### Protective goggles



# Screwed connectors


Outer thread, weld end

## Connection with external thread

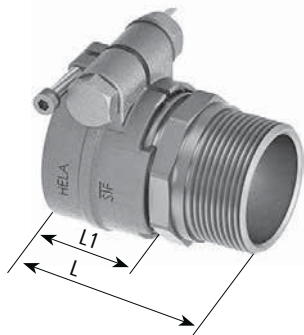

Heating, 6 bar Material: brass			Sanitary, 10 bar Material: brass		
PEX pipe mm	Screwed connector mm	L/L1 mm	PEX pipe mm	Screwed connector mm	L/L1 mm
25 x 2.3	25 x 2.3-3/4"	61/26	22 x 3.0	22 x 3.0-3/4"	61/26
32 x 2.9	32 x 2.9-1"	68/29	28 x 4.0	28 x 4.0-3/4"	63/29
40 x 3.7	40 x 3.7-1 1/4"	77/36	32 x 4.4	32 x 4.4-1"	68/29
50 x 4.6	50 x 4.6-1 1/2"	79/36	40 x 5.5	40 x 5.5-1 1/4"	79/36
63 x 5.7	63 x 5.7-2"	97/46	50 x 6.9	50 x 6.9-1 1/2"	79/36
75 x 6.8	75 x 6.8-2 1/2"	107/53	63 x 8.7	63 x 8.7-2"	97/46
90 x 8.2	90 x 8.2-3"	119/58	75 x 10.3	75 x 10.3-2 1/2"	101/53
110 x 10.0	110 x 10.0-4"	135/70	90 x 12.3	90 x 12.3-3"	116/58
125 x 11.4	125 x 11.4-5"	144/69	110 x 15.1	110 x 15.1-4"	135/70
140 x 12.7	140 x 12.7-5"	145/70	125 x 17.5	125 x 17.5-5"	136/69
160 x 14.6	160 x 14.6-6"	145/70			

## Connection with weld end

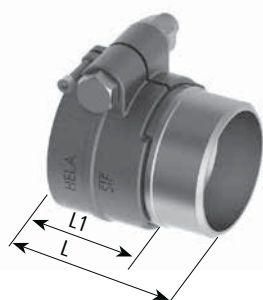

Heating, 6 bar Material: brass		
PEX pipe mm	Weld end mm	L/L1 mm
25 x 2.3	26.9 x 2.3	61/26
32 x 2.9	33.7 x 2.6	63/29
40 x 3.7	42.4 x 2.6	75/36
50 x 4.6	48.3 x 2.6	84/36
63 x 5.7	60.3 x 2.9	88/46
75 x 6.8	76.1 x 2.9	101/53
90 x 8.2	88.9 x 3.2	108/58
110 x 10.0	114.3 x 3.6	114/70
125 x 11.4	114.3 x 3.6	120/69
140 x 12.7	139.7 x 3.6	120/75
160 x 14.6	168.3 x 4.1	145/70


Heating, 10 bar Material: brass		
PEX pipe mm	Weld end mm	L/L1 mm
32 x 4.4	33.7 x 2.6	63/29
40 x 5.5	42.4 x 2.6	75/36
50 x 6.9	48.3 x 2.6	84/36
63 x 8.7	60.3 x 2.9	88/46
75 x 10.3	76.1 x 2.9	101/53
90 x 12.3	88.9 x 3.2	108/58
110 x 15.1	114.3 x 3.6	114/70
125 x 17.1	114.3 x 3.6	120/69

Note: We only recommend using press connections (CPX 1.385 - 1.395) in the soil

# Screwed connector

Coupling: equal, elbow 90°

## Coupling, equal

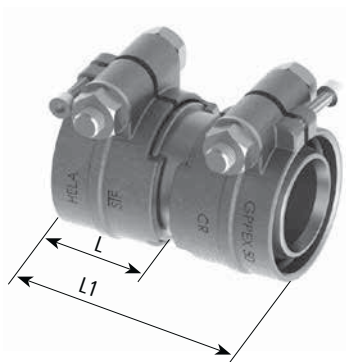

Heating, 6 bar Material: brass			Sanitary, 10 bar Material: brass		
PEX pipe mm	Coupling mm	L/L1 mm	PEX pipe mm	Coupling mm	L/L1 mm
25 x 2.3	25 x 2.3	68/26	22 x 3.0	22 x 3.0	68/26
32 x 2.9	32 x 2.9	75/29	28 x 4.0	28 x 4.0	72/29
40 x 3.7	40 x 3.7	90/36	32 x 4.4	32 x 4.4	75/29
50 x 4.6	50 x 4.6	90/36	40 x 5.5	40 x 5.5	90/36
63 x 5.7	63 x 5.7	110/46	50 x 6.9	50 x 6.9	90/36
75 x 6.8	75 x 6.8	128/52	63 x 8.7	63 x 8.7	110/46
90 x 8.2	90 x 8.2	144/58	75 x 10.3	75 x 10.3	128/52
110 x 10.0	110 x 10.0	168/70	90 x 12.3	90 x 12.3	144/58
125 x 11.4	125 x 11.4	167/69	110 x 15.1	110 x 15.1	168/70
140 x 12.7	140 x 12.7	-	125 x 17.1	125 x 17.1	167/69
160 x 14.6	160 x 14.6	168/70			

On request reduced couplings (soldered) are available

## Elbow 90°




Heating, 6 bar Material: brass soldered		Sanitary, 10 bar Material: brass soldered	
PEX pipe mm	on PEX pipe mm	PEX pipe mm	on PEX pipe mm
25 x 2.3	25 x 2.3	22 x 3.0	22 x 3.0
32 x 2.9	32 x 2.9	28 x 4.0	28 x 4.0
40 x 3.7	40 x 3.7	32 x 4.4	32 x 4.4
50 x 4.6	50 x 4.6	40 x 5.5	40 x 5.5
63 x 5.7	63 x 5.7	50 x 6.9	50 x 6.9
75 x 6.8	75 x 6.8	63 x 8.7	63 x 8.7
90 x 8.2	90 x 8.2	75 x 10.3	75 x 10.3
110 x 10.0	110 x 10.0	90 x 12.3	90 x 12.3
125 x 11.4	125 x 11.4	110 x 15.1	110 x 15.1
140 x 12.7	140 x 12.7	125 x 17.1	125 x 17.1

Note: We only recommend using press connections (CPX 1.385 - 1.395) in the soil

# Compression connectors


Outer thread, weld end

## Connector with external thread

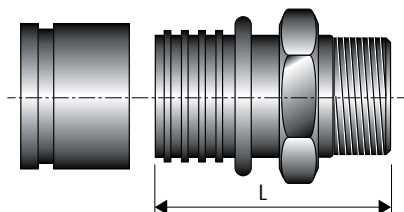

Heating, 6 bar Material: brass			Sanitary, 10 bar Material: brass		
PEX pipe mm	Screwed connector mm	L mm	PEX pipe mm	Screwed connector mm	L mm
25 x 2.3	25 x 2.3-3/4"	62	22 x 3.0	22 x 3.0-3/4"	58
32 x 2.9	32 x 2.9-1"	72	28 x 4.0	28 x 4.0-3/4"	62
40 x 3.7	40 x 3.7-1 1/4"	82	32 x 4.4	32 x 4.4-1"	72
50 x 4.6	50 x 4.6-1 1/2"	89	40 x 5.5	40 x 5.5-1 1/4"	82
63 x 5.8	63 x 5.7-2"	109	50 x 6.9	50 x 6.9-1 1/2"	89
75 x 6.8	75 x 6.8-2 1/2"	110	63 x 8.7	63 x 8.7-2"	109
90 x 8.2	90 x 8.2-3"	115			
110 x 10.0	110 x 10.0-4"	120			
125 x 11.4	125 x 11.4-5"	125			
160 x 14.6	160 x 14.6-6"	130			

## Connector with weld end

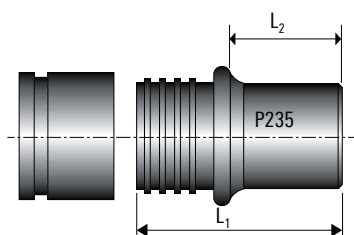


Heating, 6 bar Material: Steel (P235)			
PEX pipe mm	Weld end mm	L1 mm	L2 mm
25 x 2.3	26.9 x 2.65	50	20
32 x 2.9	33.7 x 2.3	60	24
40 x 3.7	42.4 x 2.6	70	29
50 x 4.6	48.3 x 2.6	85	37
63 x 5.8	60.3 x 2.9	90	32
75 x 6.8	76.1 x 3.2	95	35
90 x 8.2	88.9 x 3.2	95	35
110 x 10.0	114.3 x 3.6	90	30
125 x 11.4	139.7 x 3.6	108	48
140 x 12.7	139.7 x 3.6	112	50
160 x 14.6	168.3 x 4.1	114	50

Press tools see CPX 1.540

# Compression connectors


Coupling: equal, coupling: reduced, angle piece: 90°

## Coupling

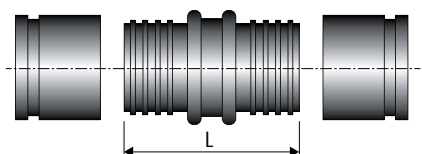


Heating, 6 bar Material: brass			Sanitary, 10 bar Material: brass		
PEX pipe mm	Coupling mm	L mm	PEX pipe mm	Coupling mm	L mm
25 x 2.3	25 x 2.3	67.0	22 x 3.0	22 x 3.0	58
32 x 2.9	32 x 2.9	88.0	28 x 4.0	28 x 4.0	70
40 x 3.7	40 x 3.7	100.0	32 x 4.4	32 x 4.4	82
50 x 4.6	50 x 4.6	114.0	40 x 5.5	40 x 5.5	90
63 x 5.8	63 x 5.7	141.0	50 x 6.9	50 x 6.9	104
75 x 6.8	75 x 6.8	137.5	63 x 8.7	63 x 8.7	122
90 x 8.2	90 x 8.2	137.5			
110 x 10.0	110 x 10.0	137.5			
125 x 11.4	125 x 11.4	141.0			
140 x 12.7	140 x 12.7	140.0			
160 x 14.6	160 x 14.6	149.0			

## Coupling, reduced

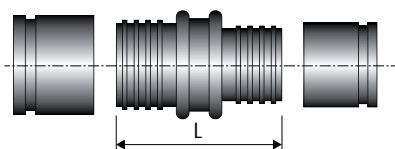

Heating, 6 bar Material: brass/steel* (P235)			Sanitary, 10 bar Material: brass		
PEX pipe mm	Coupling mm	L mm	PEX pipe mm	Coupling mm	L mm
32 x 2.9	25 x 2.3	80.0	32 x 4.4/28 x 4.0	32 x 4.4/28 x 4.0	76
40 x 3.7	32 x 2.9	100.0	40 x 5.5/32 x 4.4	40 x 5.5/32 x 4.4	86
50 x 4.6	40 x 3.7	108.0	50 x 6.9/40 x 5.5	50 x 6.9/40 x 5.5	97
63 x 5.8	50 x 4.6	129.0	63 x 8.7/50 x 6.9	63 x 8.7/50 x 6.9	113
75 x 6.8	63 x 5.8	138.0			
90 x 8.2	75 x 6.8	142.0			
110 x 10.0	90 x 8.2	142.0			
125 x 11.4*	110 x 10.1	228.0			
140 x 12.7*	125 x 11.4	220.0			
160 x 14.6*	125 x 11.4	262.0			

## Angle piece, 90°

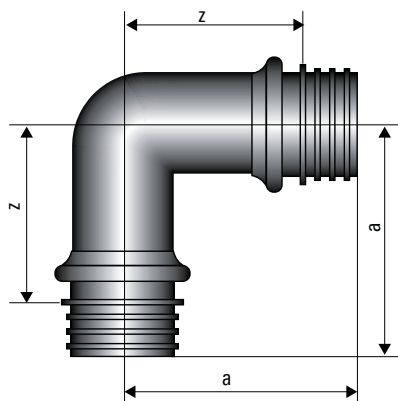


Heating, 6 bar Material: brass/steel* (P235)				Sanitary, 10 bar Material: brass			
PEX pipe mm	PEX pipe mm	a mm	z mm	PEX pipe mm	PEX pipe mm	a mm	z mm
25 x 2.3	25 x 2.3	54	32	22 x 3.0	22 x 3.0	-	-
32 x 2.9	32 x 2.9	64	37	28 x 4.0	28 x 4.0	-	-
40 x 3.7	40 x 3.7	74	42	32 x 4.4	32 x 4.4	66	39
50 x 4.6	50 x 4.6	87	48	40 x 5.5	40 x 5.5	74	42
63 x 5.8	63 x 5.8	106	60	50 x 6.9	50 x 6.9	87	39
75 x 6.8	75 x 6.8	117	67	63 x 8.6	63 x 8.6	106	60
90 x 8.2	90 x 8.2	127	76				
110 x 10.0	110 x 10.0	137	87				
125 x 11.4*	125 x 11.4	298	260				

Press tools see CPX 1.540

# Compression connectors

T-piece

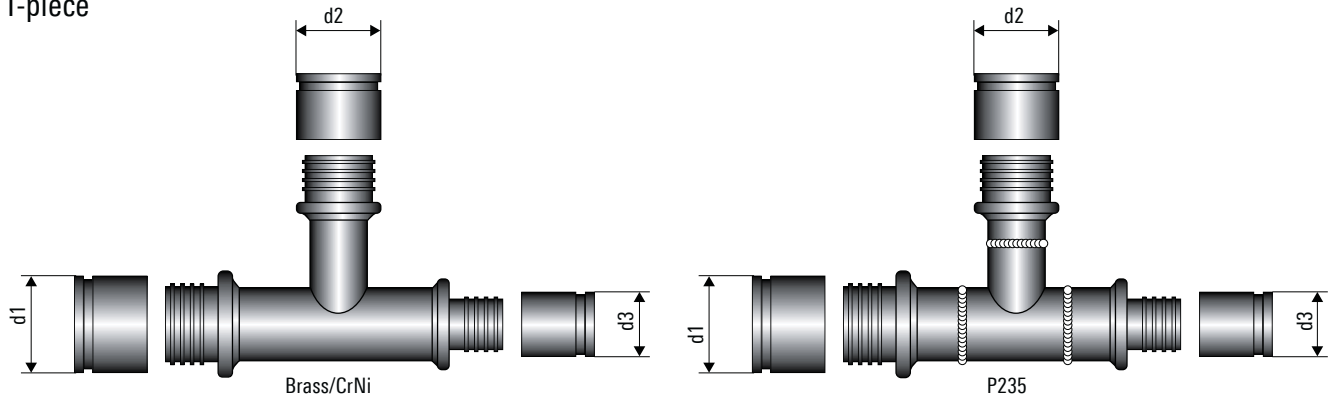

Heating, 6 bar

Ø d1 Ø d3 mm	Branch, Ø d2									
	mm									
	25 x 2.3	32 x 2.9	40 x 3.7	50 x 4.6	63 x 5.8	75 x 6.8	90 x 8.2	110 x 10.0	125 x 11.4	
25 x 2.3 - 25 x 2.3	o/x									
32 x 2.9 - 32 x 2.9	o/x	o/x								
32 x 2.9 - 25 x 2.3	o/x									
40 x 3.7 - 40 x 3.7	o/x	o/x	o/x							
40 x 3.7 - 32 x 2.9	o/x <sup>1</sup>	o/x <sup>1</sup>								
50 x 4.6 - 50 x 4.6	o/x	o/x	o/x	o/x						
50 x 4.6 - 40 x 3.7	o/x	o/x	o/x <sup>1</sup>							
63 x 5.8 - 63 x 5.8	o/x	o/x	o/x	o/x	o/x					
63 x 5.8 - 50 x 4.6	o/+	o/x	o/x	o/x						
75 x 6.8 - 75 x 6.8	o/x	o/x	o/x	o/x	o/x	o/x				
75 x 6.8 - 63 x 5.8	o/+	o/x	o/+	o/x	o/x					
90 x 8.2 - 90 x 8.2	o/+	o/x	o/x	o/+	o/x	o/+	o/x			
90 x 8.2 - 75 x 6.8	o/+	o/+	o/+	o/+	o/+	o/+				
110 x 10.0 - 110 x 10.0	o/+	o/x	o/+	o/x	o/x	o/+	o/+	o/x		
110 x 10.0 - 90 x 8.2	o/+	o/+	o/+	o/+	o/+	o/+	o/+			
125 x 11.4-125 x 11.4	o/+	o/+	o/+	o/+	o/+	o/+	o/+	o/+	o/+	o/+
125 x 11.4-110 x 10.0	o/+	o/+	o/+	o/+	o/+	o/+	o/+	o/+	o/+	o/+

<sup>1</sup> Soldered fittings


- T-pieces made of steel can be supplied on request
- Other T-pieces can be supplied on request.
- Dimension DN 150 is supplied in prefabricated and pre-insulated form (see sheet CPX 1.340).

**Material:**

- x = Brass CuZn39Pb3 (DN 20 - DN 50),  
Gunmetal Rg7 (DN 65 - DN 100)
- o = P235, welded
- + = CrNi 1.4404, 1.4432, 1.4435 (316L)

# Compression connectors

T-piece

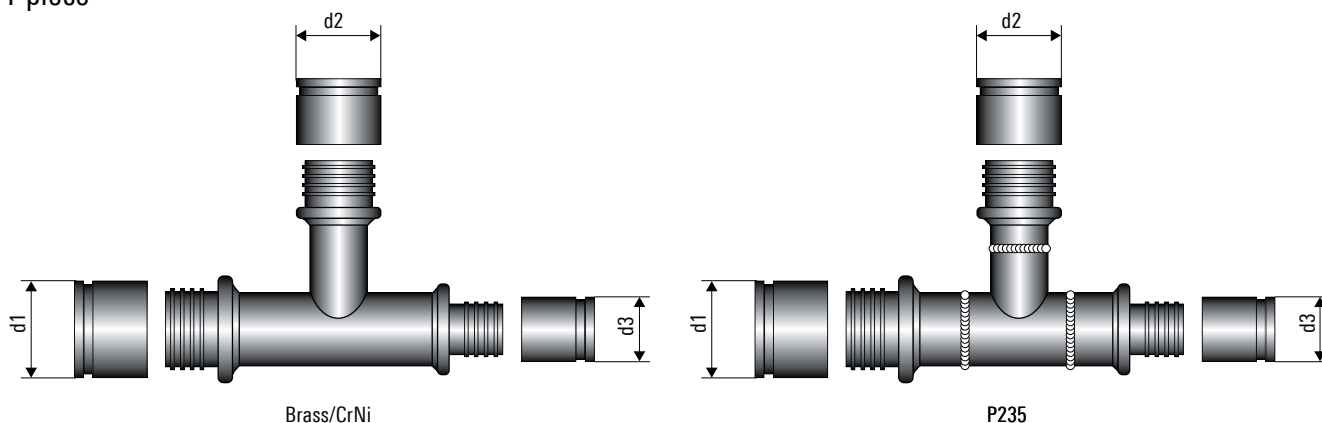

Sanitary, 10 bar

ø d1 ø d3 mm	Branch, ø d2					
	mm					
	22 x 3.0	28 x 4.0	32 x 4.4	40 x 5.5	50 x 6.9	63 x 8,7
22 x 3.0- 22 x 3.0	x	x				
28 x 4.0- 28 x 4.0	x	x	x	x		
28 x 4.0- 28 x 3.0	x					
32 x 4.4- 32 x 4.4	x	x	x	x		
32 x 4.4- 28 x 4.0	x	x	x	x		
40 x 5.5- 40 x 5.5	x	x	x	x	x	
40 x 5.5- 32 x 3.0	x	x	x	x		
40 x 5.5- 28 x 4.0	x			x	x	
50 x 6.9- 50 x 6.9	x	x	x	x	x	
50 x 6.9- 40 x 5.5	x	x	x	x	x	
50 x 6.9- 32 x 4.4	x	x	x	x	x	
50 x 6.9- 28 x 4.0		x		x	x	
63 x 8.7- 63 x 8.7	x	x	x	x	x	x
63 x 8.7- 50 x 6.9		x	x	x	x	
63 x 8.7- 40 x 5.5		x		x	x	x

<sup>1</sup> Soldered fittings

- T-pieces made of steel can be supplied on request
- Other T-pieces can be supplied on request.
- Dimension DN 150 is supplied in prefabricated and pre-insulated form (see sheet CPX 1.340).

**Material:**

- x = Brass CuZn39Pb3 (DN 20 - DN 50),  
Gunmetal Rg7 (DN 65 - DN 100)
- o = P235, welded
- + = CrNi 1.4404, 1.4432, 1.4435 (316L)

# Electro-fusion joints

Dimensions Ø 75 - 160 mm

## Coupling



Heating, 6 bar	
Material: cross-linked polyethylene	
PEX pipe mm	PEX pipe mm
50 x 4,6	50 x 4,6
63 x 5,8	63 x 5,8
75 x 6,8	75 x 6,8
90 x 8,2	90 x 8,2
110 x 10,0	110 x 10,0
125 x 11,4	125 x 11,4
160 x 14,6	160 x 14,6

## Angle piece, 90°



Heating, 6 bar	
Material: cross-linked polyethylene	
PEX pipe mm	PEX pipe mm
75 x 6,8	75 x 6,8
90 x 8,2	90 x 8,2
110 x 10,0	110 x 10,0
125 x 11,4	125 x 11,4

## Transition sleeve/joint with flange (AG)



Heating, 6 bar	
Material: cross-linked polyethylene	
PEX pipe mm	PEX pipe mm
75 x 6,8	75 x 6,8
90 x 8,2	90 x 8,2
110 x 10,0	110 x 10,0
125 x 11,4	125 x 11,4

## Reduction piece\*



Heating, 6 bar	
Material: cross-linked polyethylene	
PEX pipe mm	PEX pipe mm
90	75
110	75
110	90
125	75
125	90
125	110
160	75
160	90
160	110
160	125

## T-piece, equal



Heating, 6 bar	
Material: cross-linked polyethylene	
PEX pipe mm	PEX pipe mm
50 x 4,6	50 x 4,6
63 x 5,8	63 x 5,8
75 x 6,8	75 x 6,8
90 x 8,2	90 x 8,2
110 x 10,0	110 x 10,0
125 x 11,4	125 x 11,4

\*Note: Reductions cannot be used when using CALPEX clip shells.

## Leasable basic tool for PEXa electro-fusion joints comprising welding machine and pipe clamps



Article	
Tool set without pipe cutter	
Additional pipe clamps-set	
Pipe cutter 50-125 mm	
Pipe cutter 110-160 mm	


Only trained personnel, using suitable fusion equipment, may install the electrofusion joints for PEXa connections.




# End cap

Standard, shrinkable


Shrink-on end cap, UNO

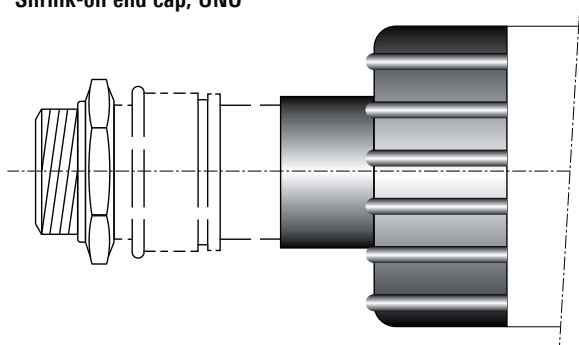


End cap, UNO (LD-PE)

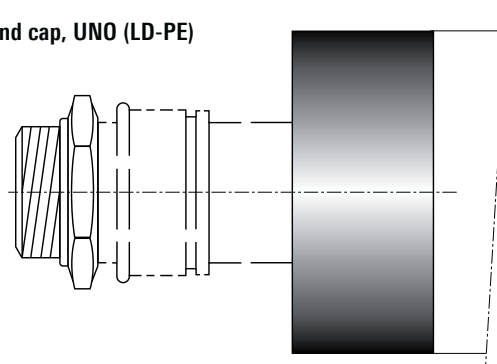


Shrink-on end cap, DUO

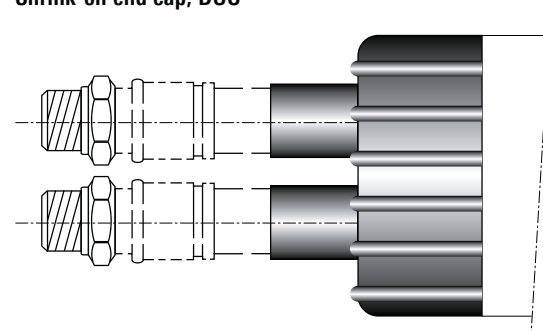


End cap, DUO (LD-PE)

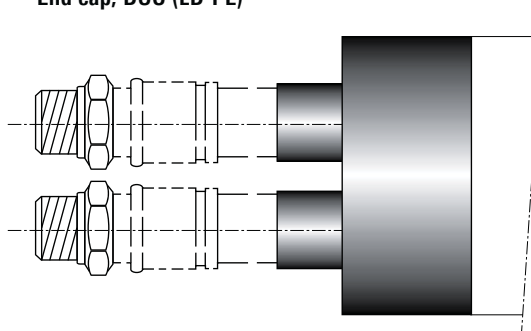

Shrink-on end cap, QUADRIGA

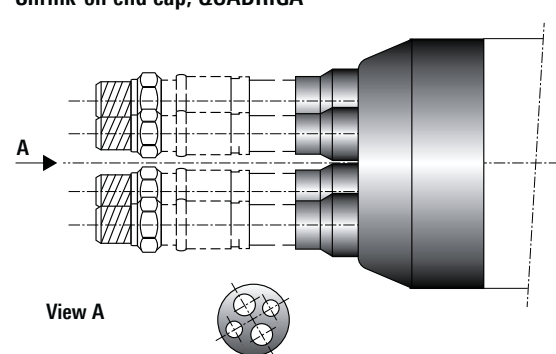

End cap, QUADRIGA (LD-PE)

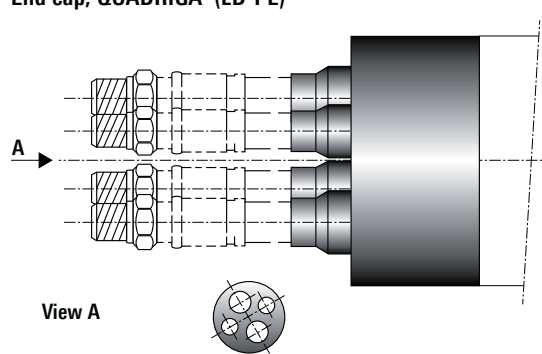

**CALPEX UNO**

Type Heating	Type Sanitary
25/ 76	22/ 76
25/ 91 PLUS	28/ 76
32/ 76	32/ 76
32/ 91 PLUS	32/111 HBK
40/ 91	40/ 91
40/111 PLUS	40/126 HBK
50/111	50/111
50/126 PLUS	50/126 HBK
63/126	63/126
63/142 PLUS	
75/142	
75/162 PLUS	
90/162	
90/182 PLUS	
110/162	
110/182	
125/182	
125/202 PLUS	
140/202	

**CALPEX DUO**

Type
25 + 25/ 91
25 + 25/111 PLUS
28 + 22/ 91
32 + 22/111
32 + 32/111
32 + 32/126 PLUS
40 + 28/126
40 + 40/126
40 + 40/142 PLUS
50 + 32/126
50 + 50/162
50 + 50/182 PLUS
63 + 63/182
63 + 63/202 PLUS
75 + 75/202


**QUADRIGA**

Type
25 + 25/28 + 22/142
32 + 32/28 + 22/142
32 + 32/32 + 22/142
40 + 40/40 + 28/162

LD-PE end caps are fitted on;  
suitable for dry rooms

# Wall sealing ring

for wall openings

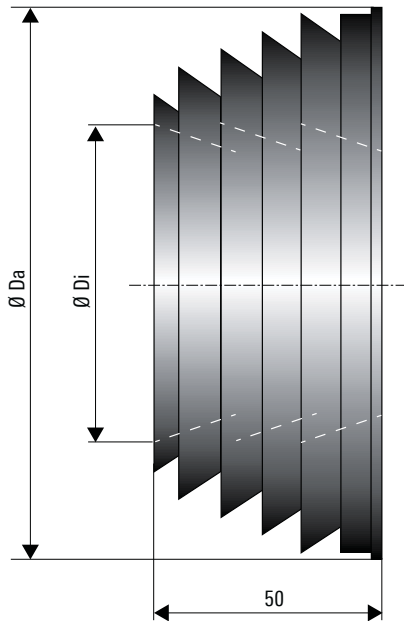

Figures in mm

## CALPEX UNO, DUO, QUADRIGA

Outer casing diameter mm	Neoprene wall sealing ring Ø Di, inner mm	Ø Da, outer mm
76	74	118
91	88	133
111	107	153
126	122	168
142	137	183
162	155	203
182	175	223
202	195	230
225	180	240
250	243	290


Building entry (see sheet CPX 1.415)

# Building entry


## Wall opening

### Wall leadthrough

PEX connection piece:  
see sheet 1.370  
or sheet 1.390

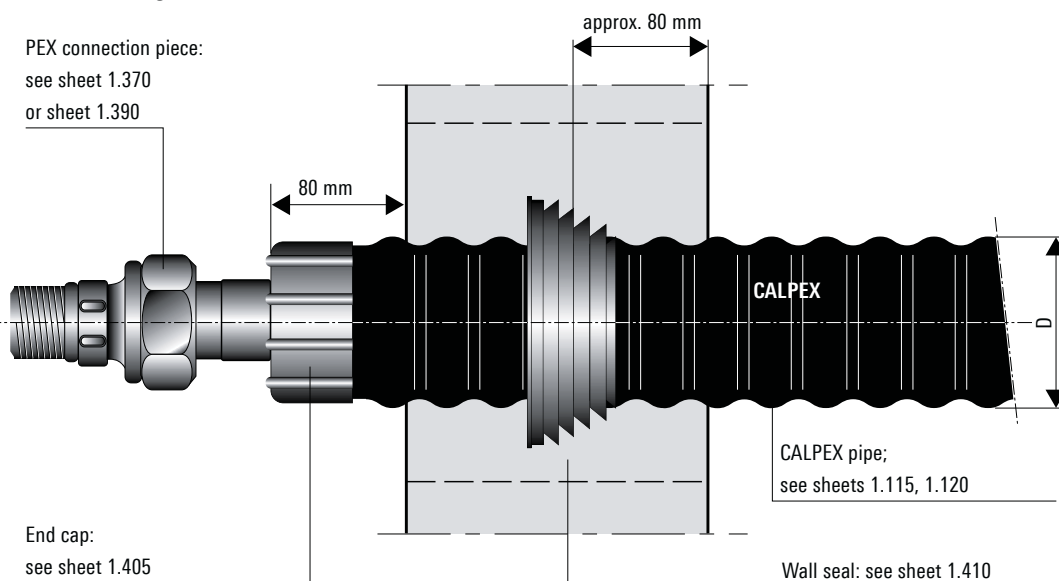


### Wall opening

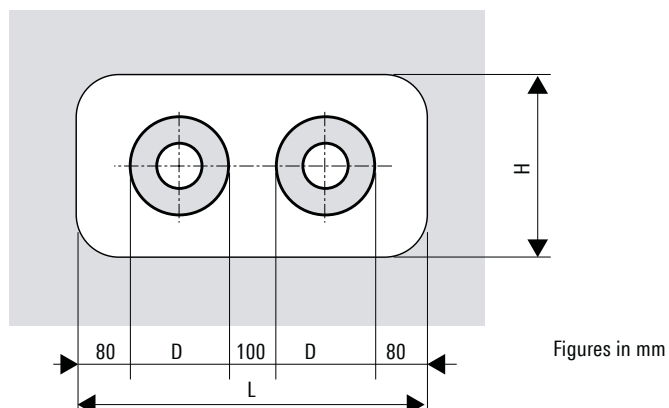

Outer casing Ø D mm	L min mm	H min mm
78	450	250
93	500	250
113	500	300
128	550	300
143	600	350
163	650	350
183	670	380
202	720	400
225	740	400
250	810	450

### Core bores

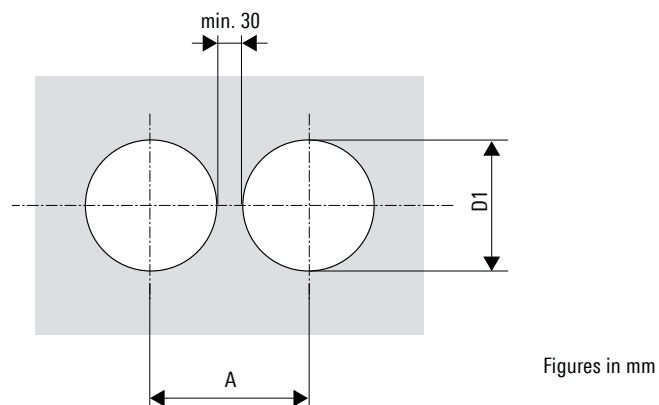


Outer casing Ø D mm	A mm	D1 mm
78	210	180
93	230	180
113	250	230
128	270	230
143	290	230
163	310	280
183	330	280
202	400	350
225	400	350
250	420	380


# Wall seal

Core bores/cement liner pipes

## Standard

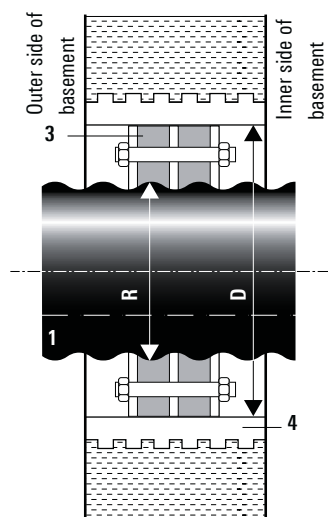

## With additional centering ring

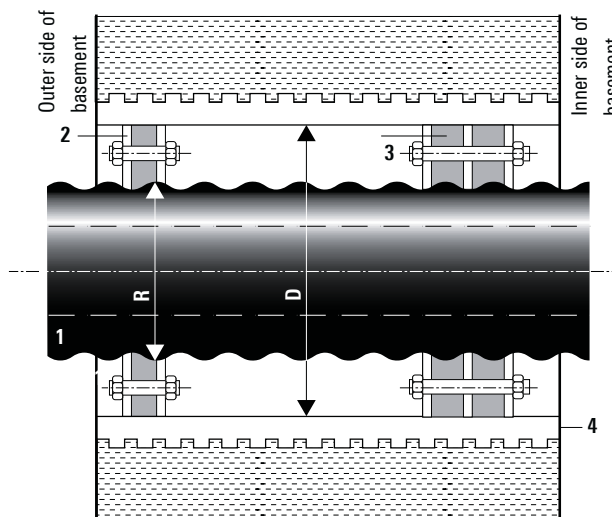

## Core bores

Perfect bores are required for installation. As hairline cracks may be present in the concrete or result from drilling, it is advisable to seal the entire length of the borehole with suitable sealant (such as AQUAGARD).

Tightness can only be guaranteed if this recommendation is followed.

Outer pipe Ø R mm	Liner pipe, core bore Ø D mm	Seal set Ø inner mm	Core bore Ø mm
76	150	78 - 85	150
91	150	86 - 94	150
111	200	105 - 115	200
126	200	125 - 135	200
142	200	137 - 145	200
162	250	157 - 165	250
182	250	180 - 190	250
202	300	198 - 207	300
225	300	225 - 233	300
250	350	250 - 259	350


Building entry (see sheet CPX 1.425)

- 1 CALPEX district heating pipe
- 2 Seal set, single-seal not suitable for pressure from water  
1 x 40 mm, Shore hardness D 35
- 3 Seal set, double-seal\* suitable for pressure from water up to 0.5 bar  
2 x 40 mm, Shore hardness D 35
- 4 Liner pipe: made of fibre cement or coated core bore


# Building entry

Core bores/cement pipe liners

## Wall leadthrough

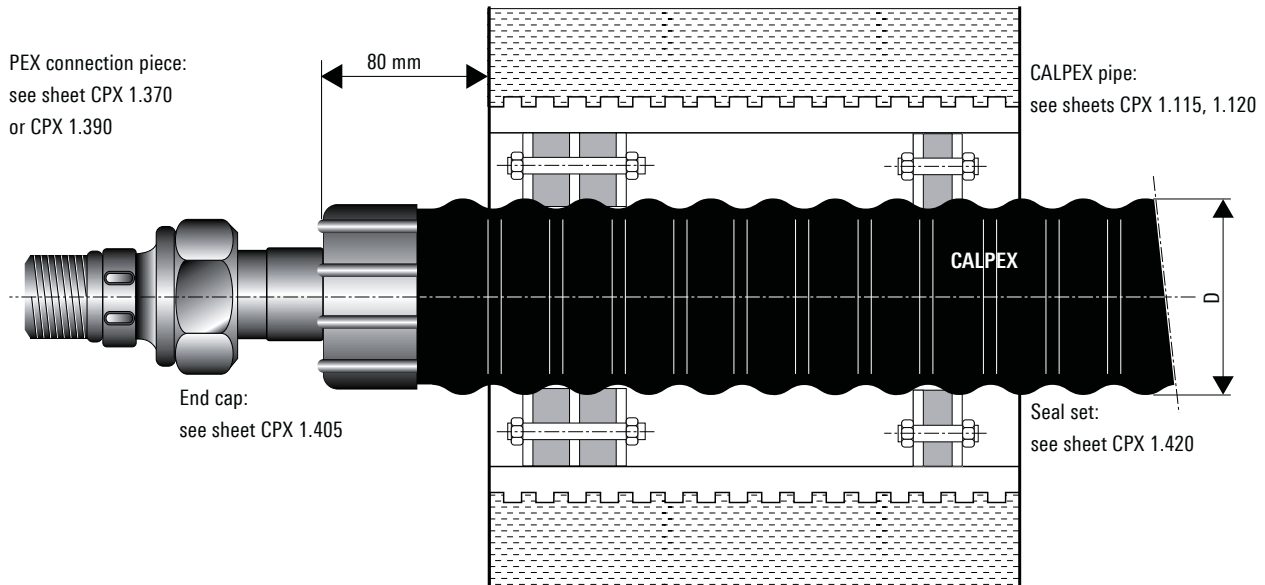


## Core bores

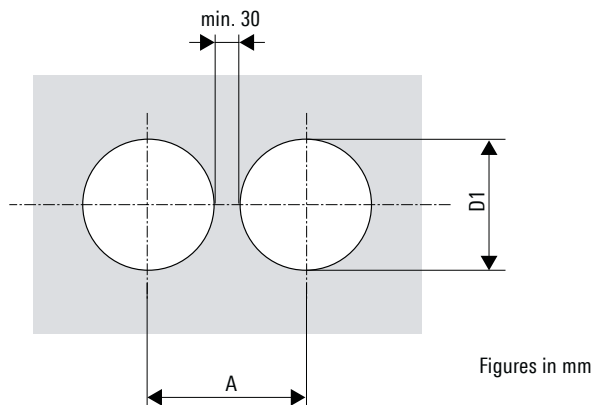


Outer casing Ø D mm	A mm	D1 mm
78	180	150
93	180	150
113	230	200
128	230	200
143	230	200
163	280	250
183	280	250
202	330	300
225	330	300
250	380	350

# Pipe routing


CALPEX – Connection to insulated steel pipe

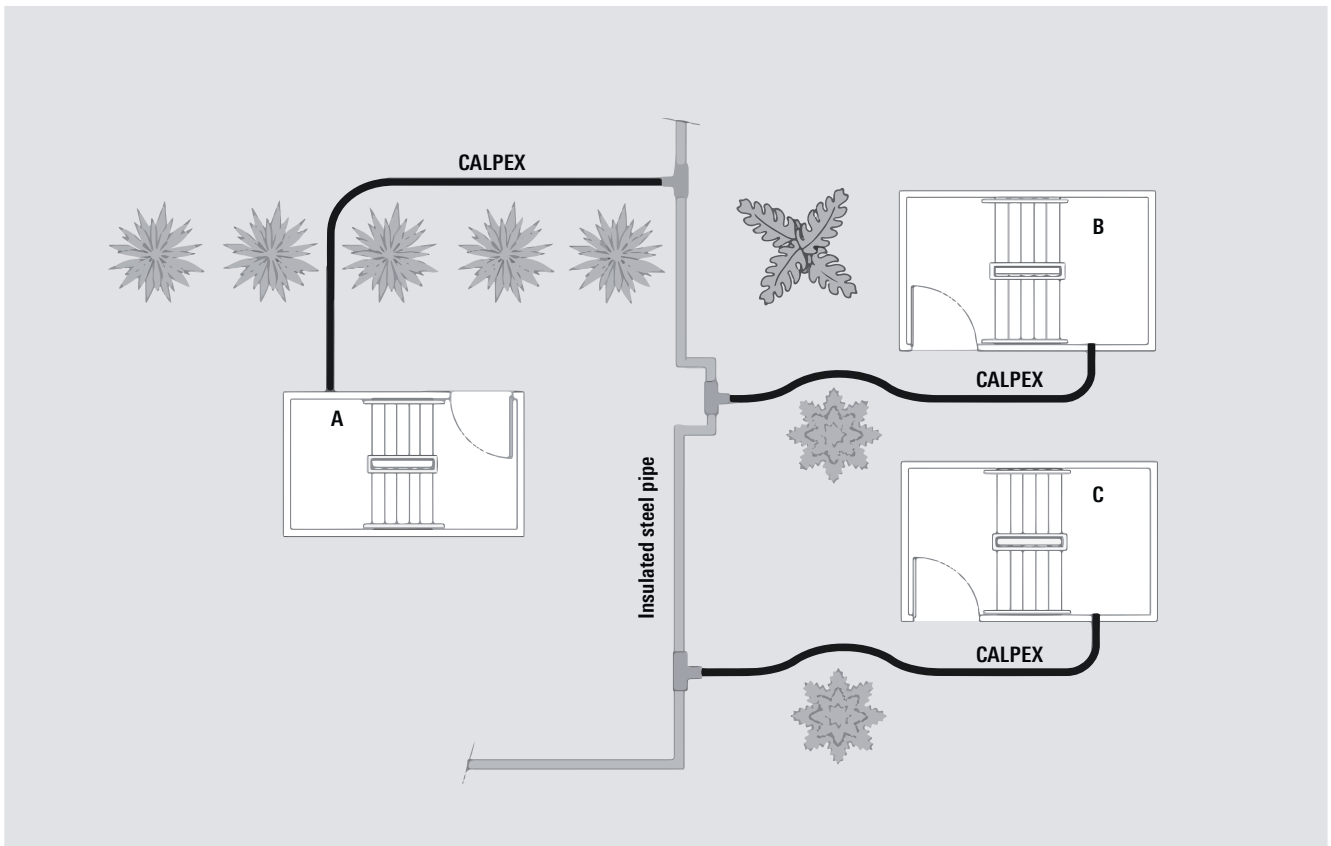

Loop-in method

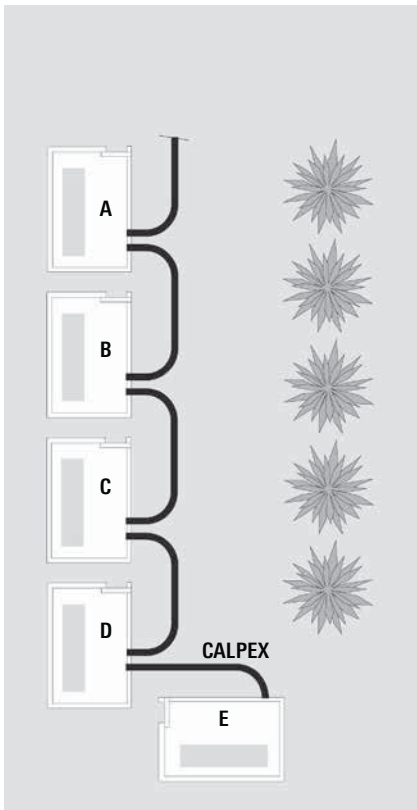


CALPEX – CALPEX connection

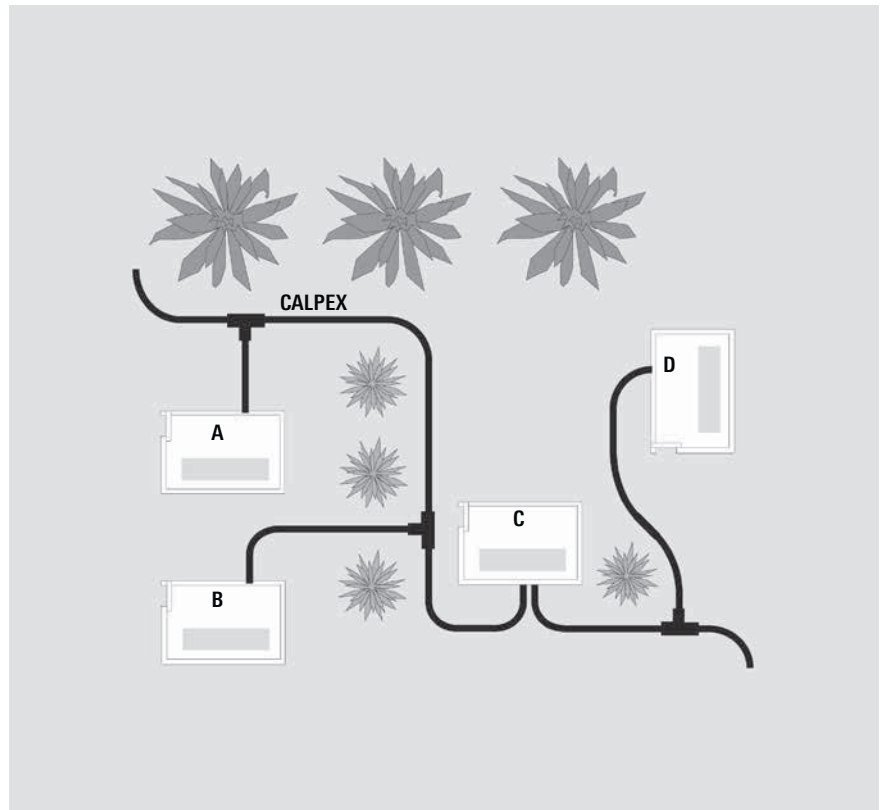


# Trench dimensions

## Trench profile, 2 CALPEX pipes

UNO

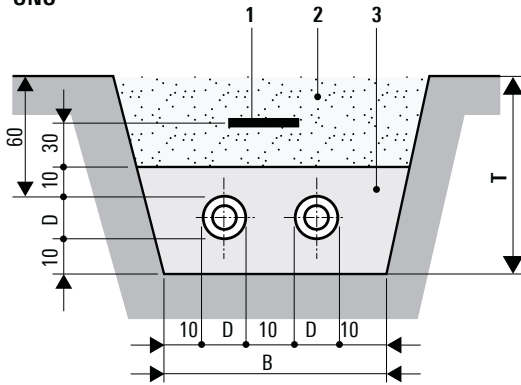

DUO, QUADRIGA

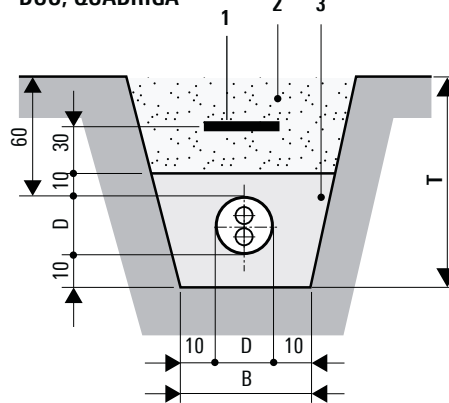


Figures in cm

Casing pipe Ø D mm	Width B cm	Depth T cm	Minimum bending radius m
78	45	80	0.7
93	50	80	0.8
113	55	85	0.9
128	55	85	1.0
143	60	85	1.1
163	65	90	1.2
183	70	95	1.4
202	75	95	1.4
250	80	100	-


Casing pipe Ø D mm	Width B cm	Depth T cm	Minimum bending radius m
93	30	80	0.8
113	30	85	0.9
128	35	85	1.0
143	35	85	1.1
163	35	90	1.2
183	38	95	1.4
202	40	95	1.4

## Trench profile, 4 CALPEX pipes

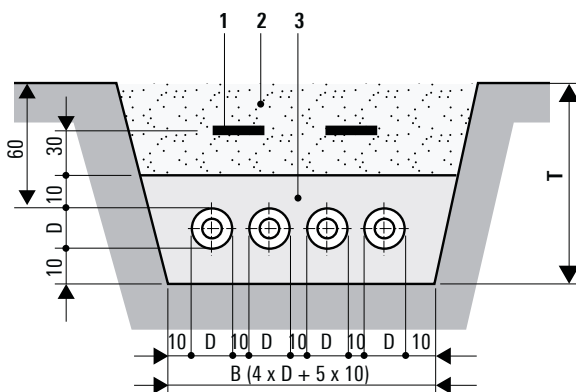

- 1 Pipe warning tape; see sheet CPX 1.430
- 2 Excavated material
- 3 Fill material see below

Installation depth:  
Max. installation depth: 2.6 m  
Our approval is required for installation at greater depths.

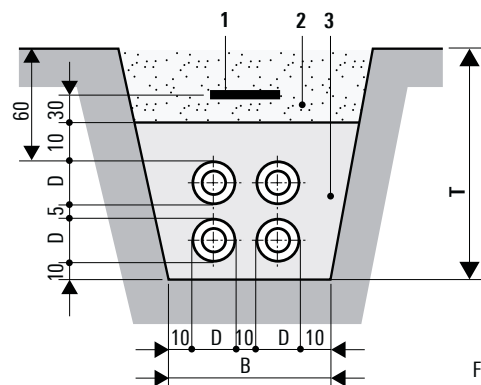

Figures in cm

SLW 30  $\hat{=}$  300 kN total load as per DIN 1072; if subject to higher traffic loads (e.g. SLW 60), a load-distributing superstructure as per RSt075 is required.


With no traffic load, the minimum trench depth **T** can be reduced by 20 cm.

The fill material in the embedment must comply with EN 13941-2 and satisfy the following minimum requirements:

- Friable, round-edged sand-gravel mixture
- Permissible grain size: 0...8 mm
- Coefficient of uniformity according to DIN EN ISO 14688-2 larger than 1.8
- Maximum 10 percent by mass  $\leq$  0.075 mm
- Maximum 3 percent by mass  $\leq$  0.02 mm
- Proctor density min. 94%; optimal 97 up to 98%


# Pipe warning tape

## CALPEX pipe warning tape

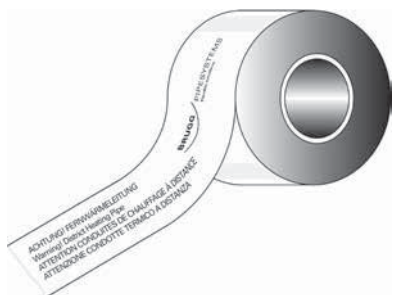

Pipe warning tape to be laid in the ground.  
Roll length: 250 m

## CALPEX trench structure

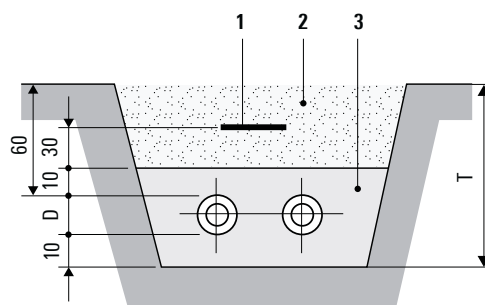

- 1 Pipe warning tape
- 2 Excavated material
- 3 Washed sand

Installation depth; see sheet CPX 1.505

## Laying tools

Using the CALPEX unwinding device and the CALPEX – power winch makes it possible to easily and quickly unroll and lay the flexible composite pipe systems.

### CALPEX-Unwinding device



Dimension: Ø 400 x 157 cm  
Load capacity: 1'000 kg


### Power winch



Our recommendation:  
<https://www.portablewinch.com>

### CALPEX-Squeezing device

for temporary closing up PE- and PEX-pipes

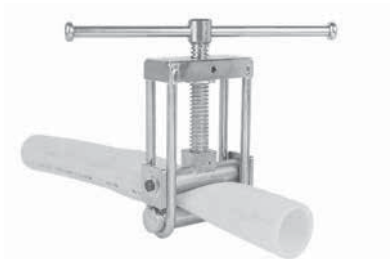

Squeezing device Ø 32 – 63 mm (SDR11)



Squeezing device Ø 75 - 160 mm (SDR11)




# Connection (rigid/flexible)


CALPEX to insulated steel pipes

Installation instructions for transition from CALPEX to insulated steel pipe (KMR)

## 1. Junction with T-piece

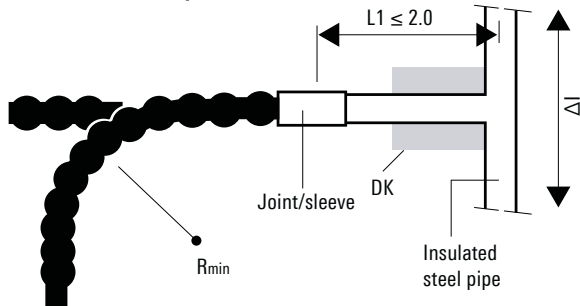

## 2. Transition with fixed point

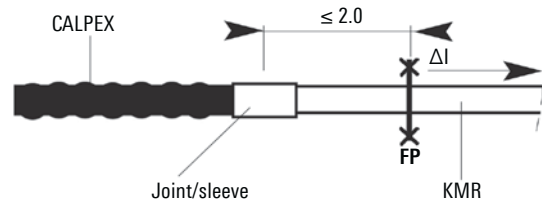


Figures in m


The transverse expansion  $\Delta I$  must not exceed the expansion that can be accommodated by junction pipe DS and the CALPEX pipe.

The thermal movement  $\Delta I$  of the insulated steel pipe cannot be compensated by the CALPEX pipes. A fixed point must be installed.

## 3. Transition with Z-bend

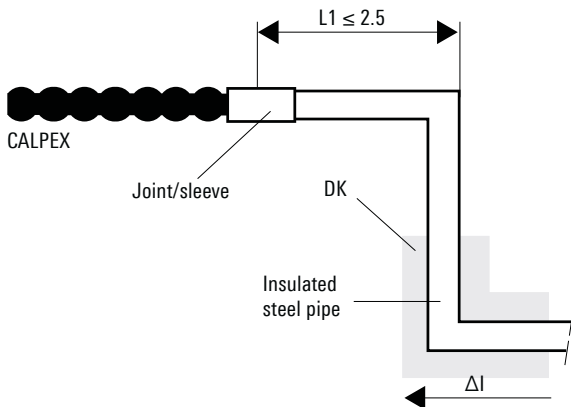

## 4. Transition with expansion bend

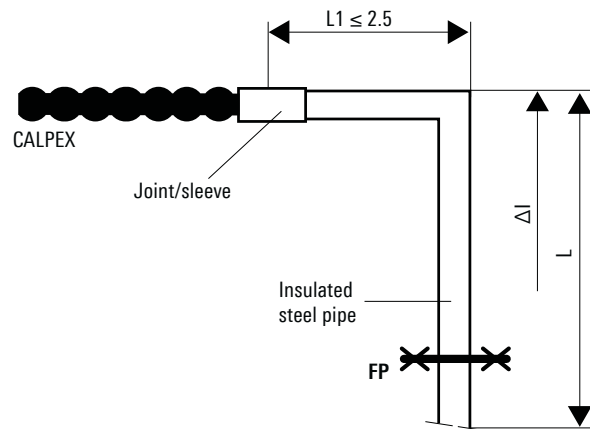

Figures in m

Static design of the Z-bend according to expansion variable  $\Delta I$ .

If pipe length  $L$  or  $\Delta I$  is more than permitted for  $L1$ , a fixed anchor point must be installed.


- $\Delta I$  = Thermal movement
- FP = Fixed point (plastic casing pipe)
- DK = Expansion pad

- Design of expansion components
- Positioning of expansion pads as per the section on PREMANT


# House entry, screwed connector/ compression joint

Shaft entry


## Connection with external thread

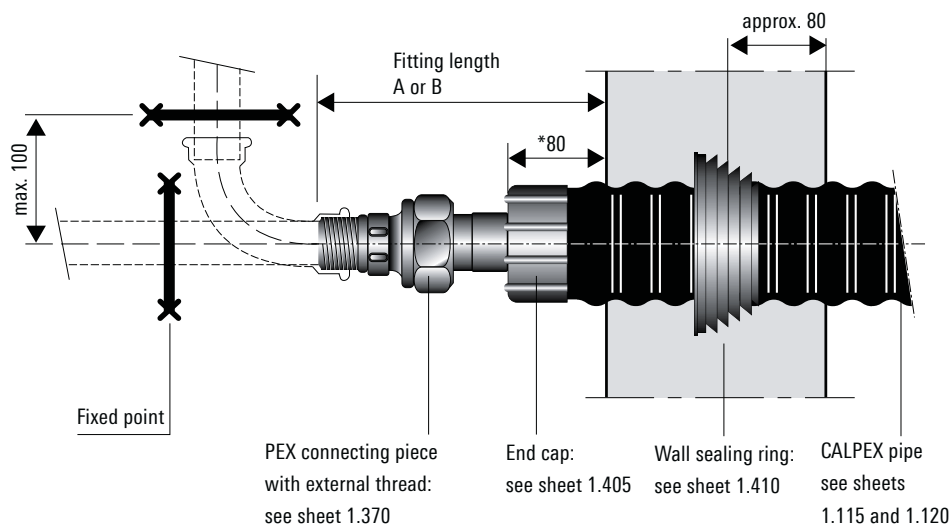

### Screwed connector

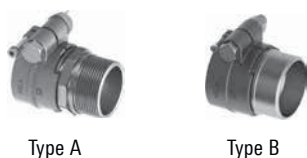

### Compression joint

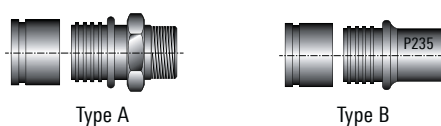


Heating, 6 bar PEX-Pipe mm	Fitting lengths	
	A mm	B mm
25 x 2.3	190	190
32 x 2.9	195	190
40 x 3.7	200	200
50 x 4.6	205	210
63 x 5.8	225	215
75 x 6.8	230	225
90 x 8.2	245	235
110 x 10.0	260	240
125 x 11.4	270	250
140 x 12.7	270	250
160 x 14.6	270	270
Sanitary, 10 bar		
22 x 3.0	190	190
28 x 4.0	190	190
32 x 4.4	195	200
40 x 5.5	205	210
50 x 6.9	205	210
63 x 8.7	220	215
75 x 10.3	230	225
90 x 12.3	240	235
110 x 15.1	260	240
125 x 17.5	260	250

Heating, 6 bar PEX-Pipe mm	Fitting lengths	
	A mm	B mm
25 x 2.3	260	250
32 x 2.9	260	250
40 x 3.7	270	260
50 x 4.6	270	270
63 x 5.8	320	310
75 x 6.8	320	310
90 x 8.2	330	310
110 x 10.0	340	310
125 x 11.4	340	310
160 x 14.6	340	340
Sanitary, 10 bar		
22 x 3.0	260	
28 x 4.0	260	
32 x 4.4	260	
40 x 5.5	270	
50 x 6.9	270	
63 x 8.7	320	

# House entry, compression joint

## Fixed point forces

### Connection with external thread

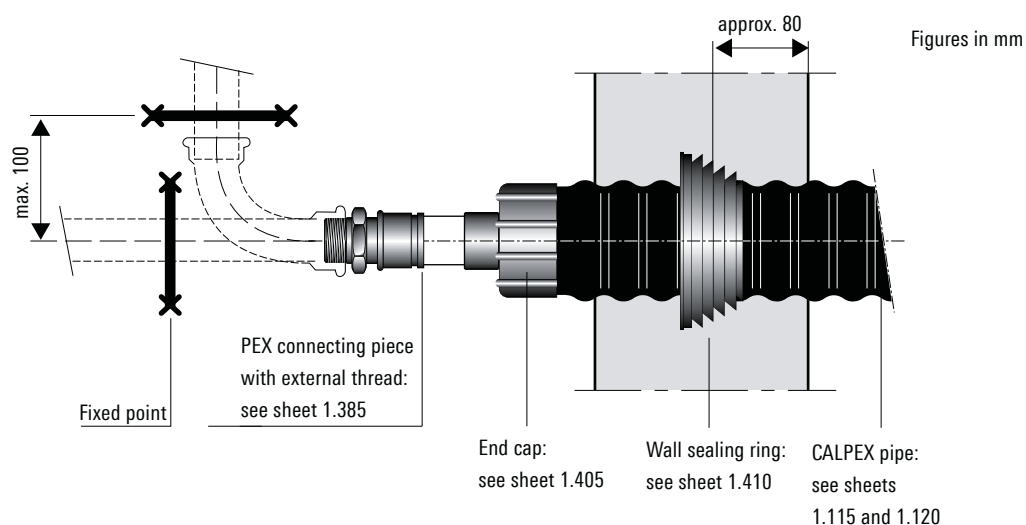

### Fixed point forces occurring CALPEX heating, 6 bar

Maximum fixed point forces occurring per pipe for:

Type	Type	TB = 60 °C, pB = 6 bar Fmax [N]	TB = 90 °C, pB = 6 bar Fmax [N]
25/ 76	25/ 91 PLUS	640	924
32/ 76	32/ 91 PLUS	1036	1493
40/ 91	40/111 PLUS	1639	2367
50/111	50/126 PLUS	2553	3686
63/126	63/142 PLUS	4013	5782
75/142	75/162 PLUS	5693	8205
90/162	90/182 PLUS	8228	11864
110/182	110/202 PLUS	12260	17675
125/182	125/202 PLUS	15872	22888
140/202		19928	28747
160/250		26004	37502

### CALPEX sanitary, 10 bar

Maximum fixed point forces occurring per pipe for:

TB = 60 °C, pB = 10 bar		
Typ	DN	Fmax [N]
22/ 76	16	820
28/ 76	20	1350
32/ 76	25	1730
40/ 91	32	2700
50/111	40	4230
63/126	50	6715

### Fixed points



# Installation of house entry



1 Mark the distance (x, y, z) + 1 cm from the end of the pipe.



2 Cut the casing pipe with saw.



3 Split the casing pipe with knife.  
**Note: Don't damage the carrier pipe!**




4 Peel off the casing.



5 Cut back/remove the insulation along length (X, Y, Z).  
**Note: Don't damage the carrier pipe!**




6 Install the wall sealing ring.

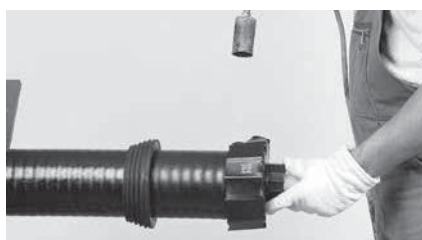

7 Carefully shrink on the pipe end closure according to the Raychem DHEC installation instruction.




8 Install the fitting as per the enclosed installation instructions.

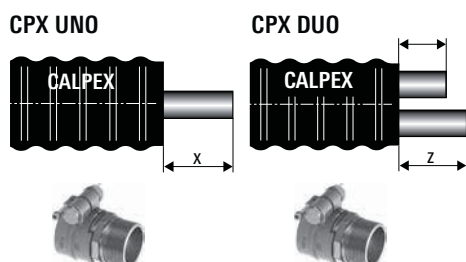

**UNO screwed connector**  
House connection:  
ø 22 - 75: X = 90 mm  
ø 90 - 110: X = 110 mm

**DUO screwed connector**  
House connection:  
ø 22 - 75: Y = 80 mm  
ø 22 - 75: Z = 180 mm

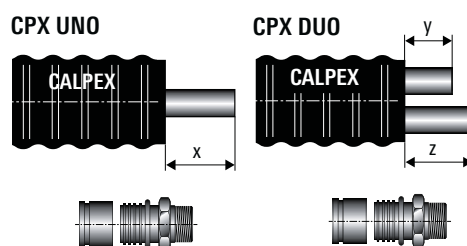

**UNO compression joint**  
House connection:  
ø 22 - 50: X = 140 mm  
ø 63 - 125: X = 180 mm  
Joint/sleeve:  
ø 22 - 50: X = 110 mm  
ø 63 - 110: X = 140 mm  
ø 125 - 160: X = 150 mm


**DUO compression joint**  
House connection:  
ø 22 - 50: Y,Z = 140 mm  
ø 63 - 75: Y,Z = 160 mm  
Joint/sleeve:  
ø 22 - 50: Y,Z = 110 mm  
ø 63 - 75: Y,Z = 140 mm

**Note: Install the CPX-Clip-Shells according to the installation instruction!**


# Installation tools

general and for screwed connector


## Cut to length and strip insulation

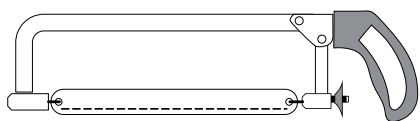

The saw is used to cut the casing pipe and the insulation

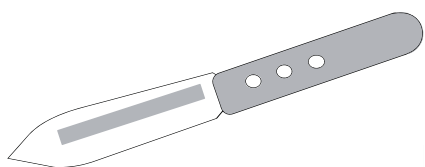


Knife to split casing and remove insulation

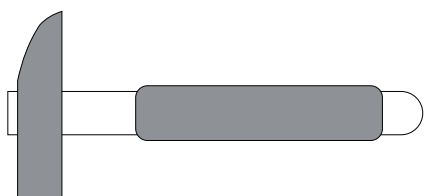


Hammer as auxiliary tool

## Fit of connection piece

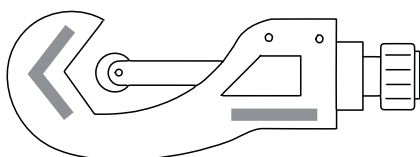


Pipe cutter for PEX pipe

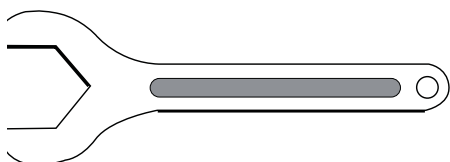

Spanner wrench


## Shrink procedure

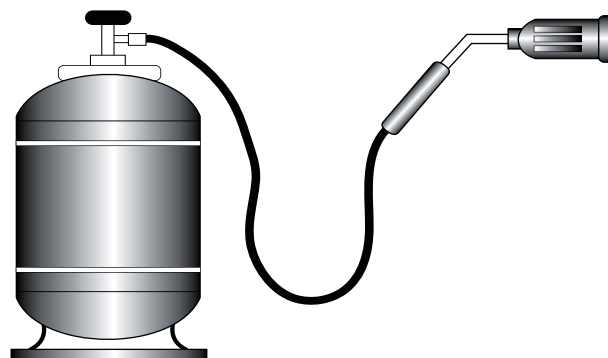


The gas burner is used to shrink hoses and joints



It is recommended that gloves are worn for shrinking work.

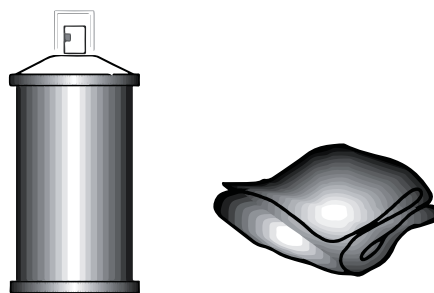

Cleaning products and cleaning cloths

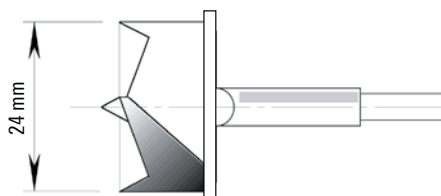


Flat bit for cutting filler hole


# Installation tools

for press fit joints

## Manual tool for PEX Ø 22 - 40 mm (packed in one case)




Expander tool, up to Ø 32 mm  
(basic tool)




Press tool, up to Ø 40 mm  
Expander tool for Ø 40 mm  
(basic tool)




Case with basic tool  
including head and yoke



Expander head, up to Ø 32 mm

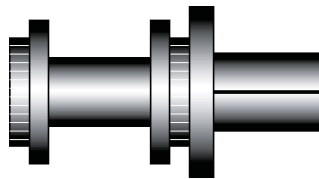


Expander head, over Ø 40 mm



Press yoke, Ø 22 - 40 mm


## Hydraulic tool for PEX Ø 50 - 110 mm (packed in two cases)

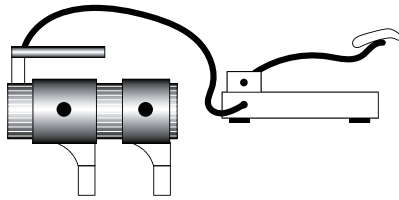


Hydraulic press and expander tool  
Ø 50 - 110 mm including foot pump (basic tool)




Case with basic tool  
(without heads and yoke)



Expander head  
Ø 50 - 110 mm



Press yoke  
Ø 50, 63 mm




Reducer Ø 75/90 mm  
for yoke, Ø 110 mm




Case with expander heads  
and press yoke


## Electro-hydraulic tool for PEX Ø 125 - 160 mm (packed in two cases)

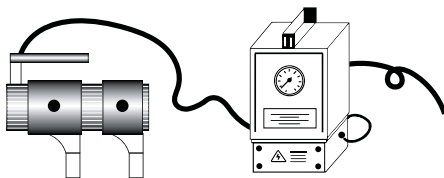


Hydraulic press and expander tool  
Ø 125 - 160 mm including foot pump (basic tool)




Case with basic tool  
(without heads and yoke)



Expander head  
Ø 125 - 160 mm



Press yoke  
Ø 140 mm, 160 mm



Reducer Ø 125 mm  
for yoke, Ø 160 mm




Case with expander heads  
and press yoke

# Heating strip, sanitary, 10 bar

Drawing in, sensor, joint

## 1. Pulling through the heating strip

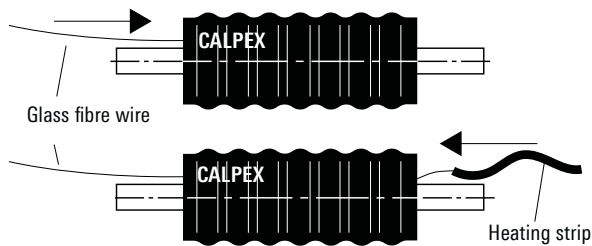


1. Unroll the pipe so that it is straight, next to the trench (without bends). See also CPX 1.120. Shorten the casing and cut back the channel. From one end, push the glass fibre wire (ø 6.5 mm) through the channel. The heating strip can be pushed in for straight lengths of up to 30 m.


2. Connect the heating strip or pull cord to the wire (drill a hole in the strip) and pull through the heating strip.

## 2. Installation of the temperature sensor for frost protection

The temperature sensor has to be installed on the carrier pipe, opposite the heating strip. It must be installed at the coldest point of the pipe (outside the building). For this purpose, cut open an area of the casing measuring 10 x 7 cm and peel it off, cut open 10 x 7 cm of foam, fix the temperature sensor onto the carrier pipe with adhesive tape, fill the hole with the insulation material supplied, apply filling adhesive S1113 below and above the temperature sensor cable (see Detail B), and seal with the sealing set.

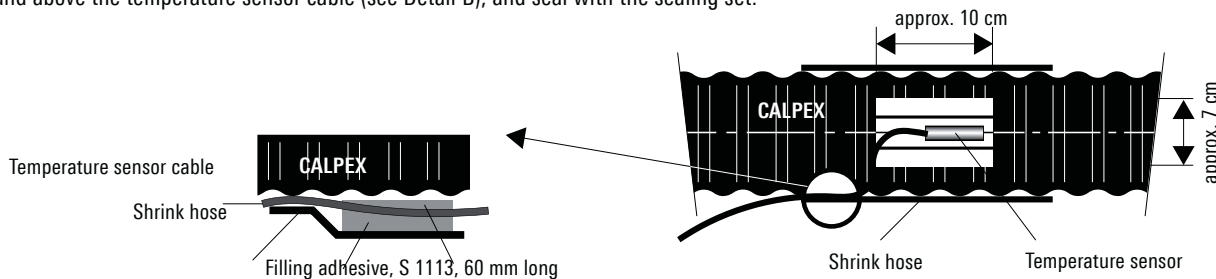

## 3. Remove the insulation


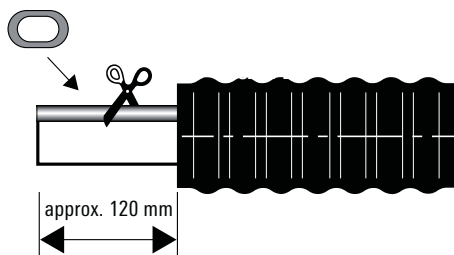


Shorten the casing by 120 mm and cut off the exposed channel.

## 4. Joint

Through connection  $L \leq L_{max}^*$   
Feed in from one end

Separate of heating strips  $L > L_{max}^*$   
Feed in from both end (each strip  $\leq L_{max}$ )

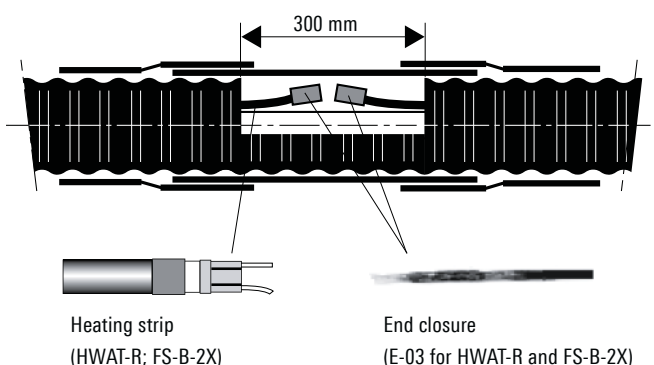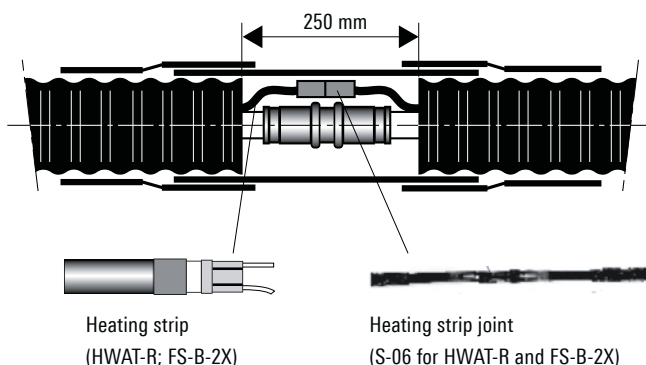

Protect the heating strip against moisture  
\*  $L_{max}$  = max. permitted length for heating strip

The heating strip and the accessories are supplied and installed by the electrician!